


Document Path: \\t\local\vol572\GIS\215878NW_M033\215878NW_M033\215878NW_M033_ParrC_3.aprx Layout: 215878NW_M033_R12_F06_22_GIS_1

Figure 6.22
Air quality sensitive
receivers in the study
area (map 7 of 10)

- Legend**
- 220 kV dual monopoles
 - Proposed tower
 - ▲ Sensitive receiver
 - Proposed 220 kV OHTL
 - Relocated 110 kV OHTL
 - Existing 220kV OHTL
 - Existing 110kV OHTL
 - Major road
 - Watercourses
 - Proposed easement
 - Cadastre
 - Study area (500 m buffer of vegetation clearance)
 - Proposed access tracks
 - New track
 - Existing upgrade required

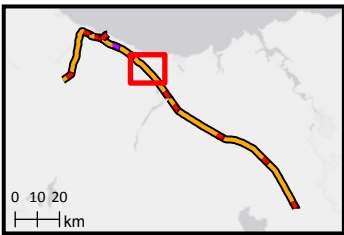


N
Scale (A4): 1:75,000

1 0 1
km

Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994

Date: 7/01/2026 11:08 AM
Prepared by: Tetra Tech Coffey

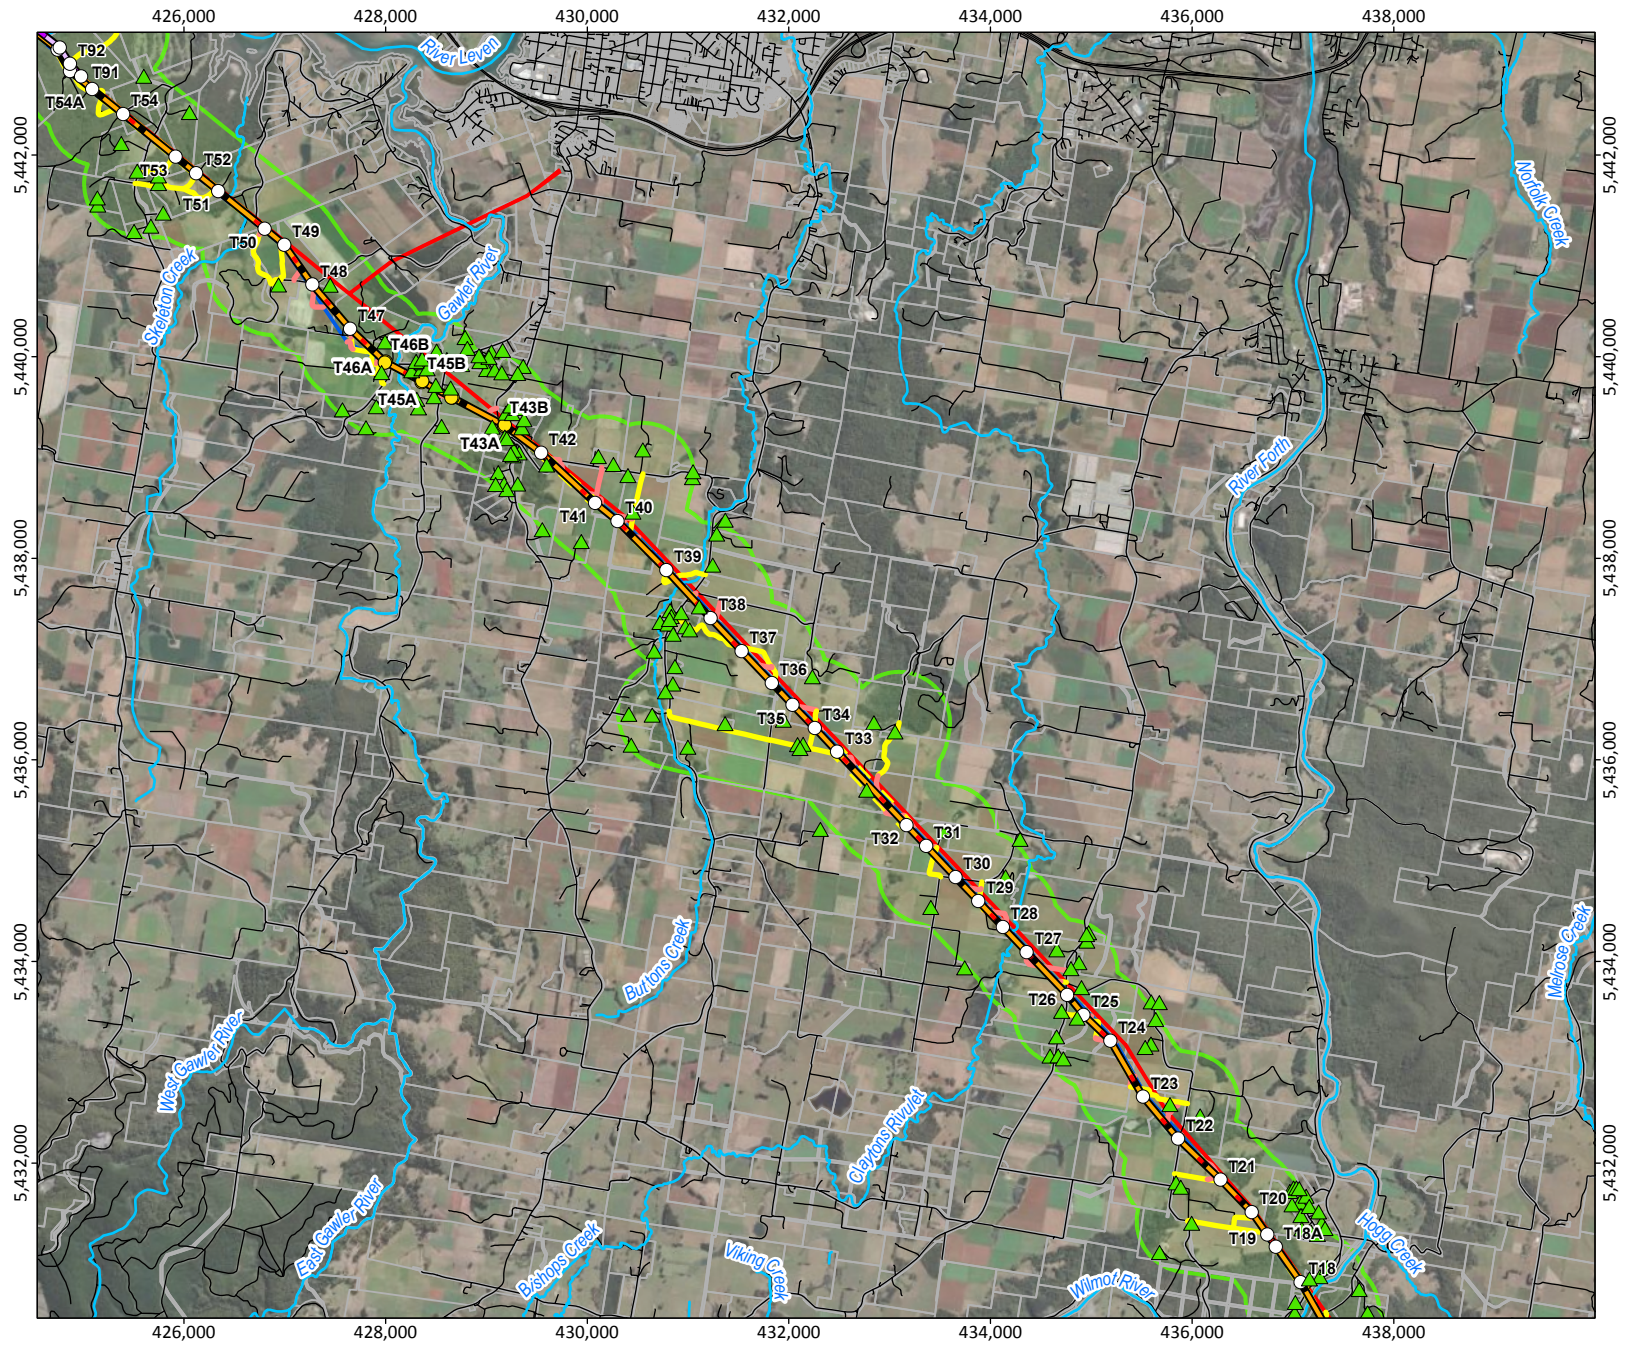


Source: Proposed routes and existing transmission lines from TasNetworks. Receivers from Tetra Tech Coffey. Place names, roads and watercourses from DNRET. Imagery from ESRI Online.
TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2026

Document Path: \\t\local\vol\5772\GIS\215878NW_M033\215878NW_M033_Parc 3.aprx Layout: 215878NW_0335_A12_F06_22_GIS_1

Figure 6.22
Air quality sensitive
receivers in the study
area (map 8 of 10)

Legend

- Other switching station/substation*
- Proposed 220 kV dual monopoles
- Proposed tower
- Sensitive receiver
- Proposed 220 kV OHTL
- Relocated 110 kV OHTL
- Existing 220kV OHTL
- Existing 110kV OHTL
- Major road
- Watercourses
- Proposed easement
- Cadastre
- Study area (500 m buffer of vegetation clearance)
- Proposed access tracks
 - New track
 - Existing upgrade required
 - Existing

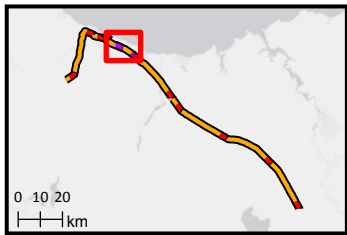

N
Scale (A4): 1:75,000
1 0 1 km
Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994
Date: 7/01/2026 11:08 AM
Prepared by: Tetra Tech Coffey




Source: Proposed routes and existing transmission lines from TasNetworks. Receivers from Tetra Tech Coffey. Place names, roads and watercourses from DNRET. Imagery from ESRI Online.
TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2026
*Heybridge and Staverton switching stations are new stations proposed under separate projects.


Document Path: \\t\local\vol572\GIS\215878NW_M033\215878NW_M033_Parc 3.aprx Layout: 215878NW_0335_A12_FIG 22 GIS 1

Figure 6.22
Air quality sensitive
receivers in the study
area (map 9 of 10)

- Legend**
- Existing substation to be modified
 - 220 kV dual monopoles
 - Proposed tower
 - Sensitive receiver
 - Proposed 220 kV OHTL
 - Relocated 110 kV OHTL
 - Existing 220kV OHTL
 - Existing 110kV OHTL
 - Major road
 - Watercourses
 - Proposed easement
 - Cadastre
 - Study area (500 m buffer of vegetation clearance)
- Proposed access tracks**
- New track
 - Existing upgrade required
 - Existing


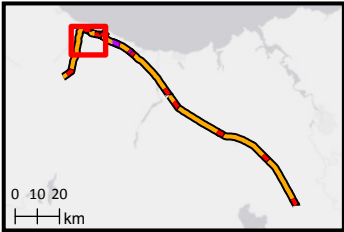


N
Scale (A4): 1:75,000
1 0 1 km
Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994
Date: 7/01/2026 11:08 AM
Prepared by: Tetra Tech Coffey

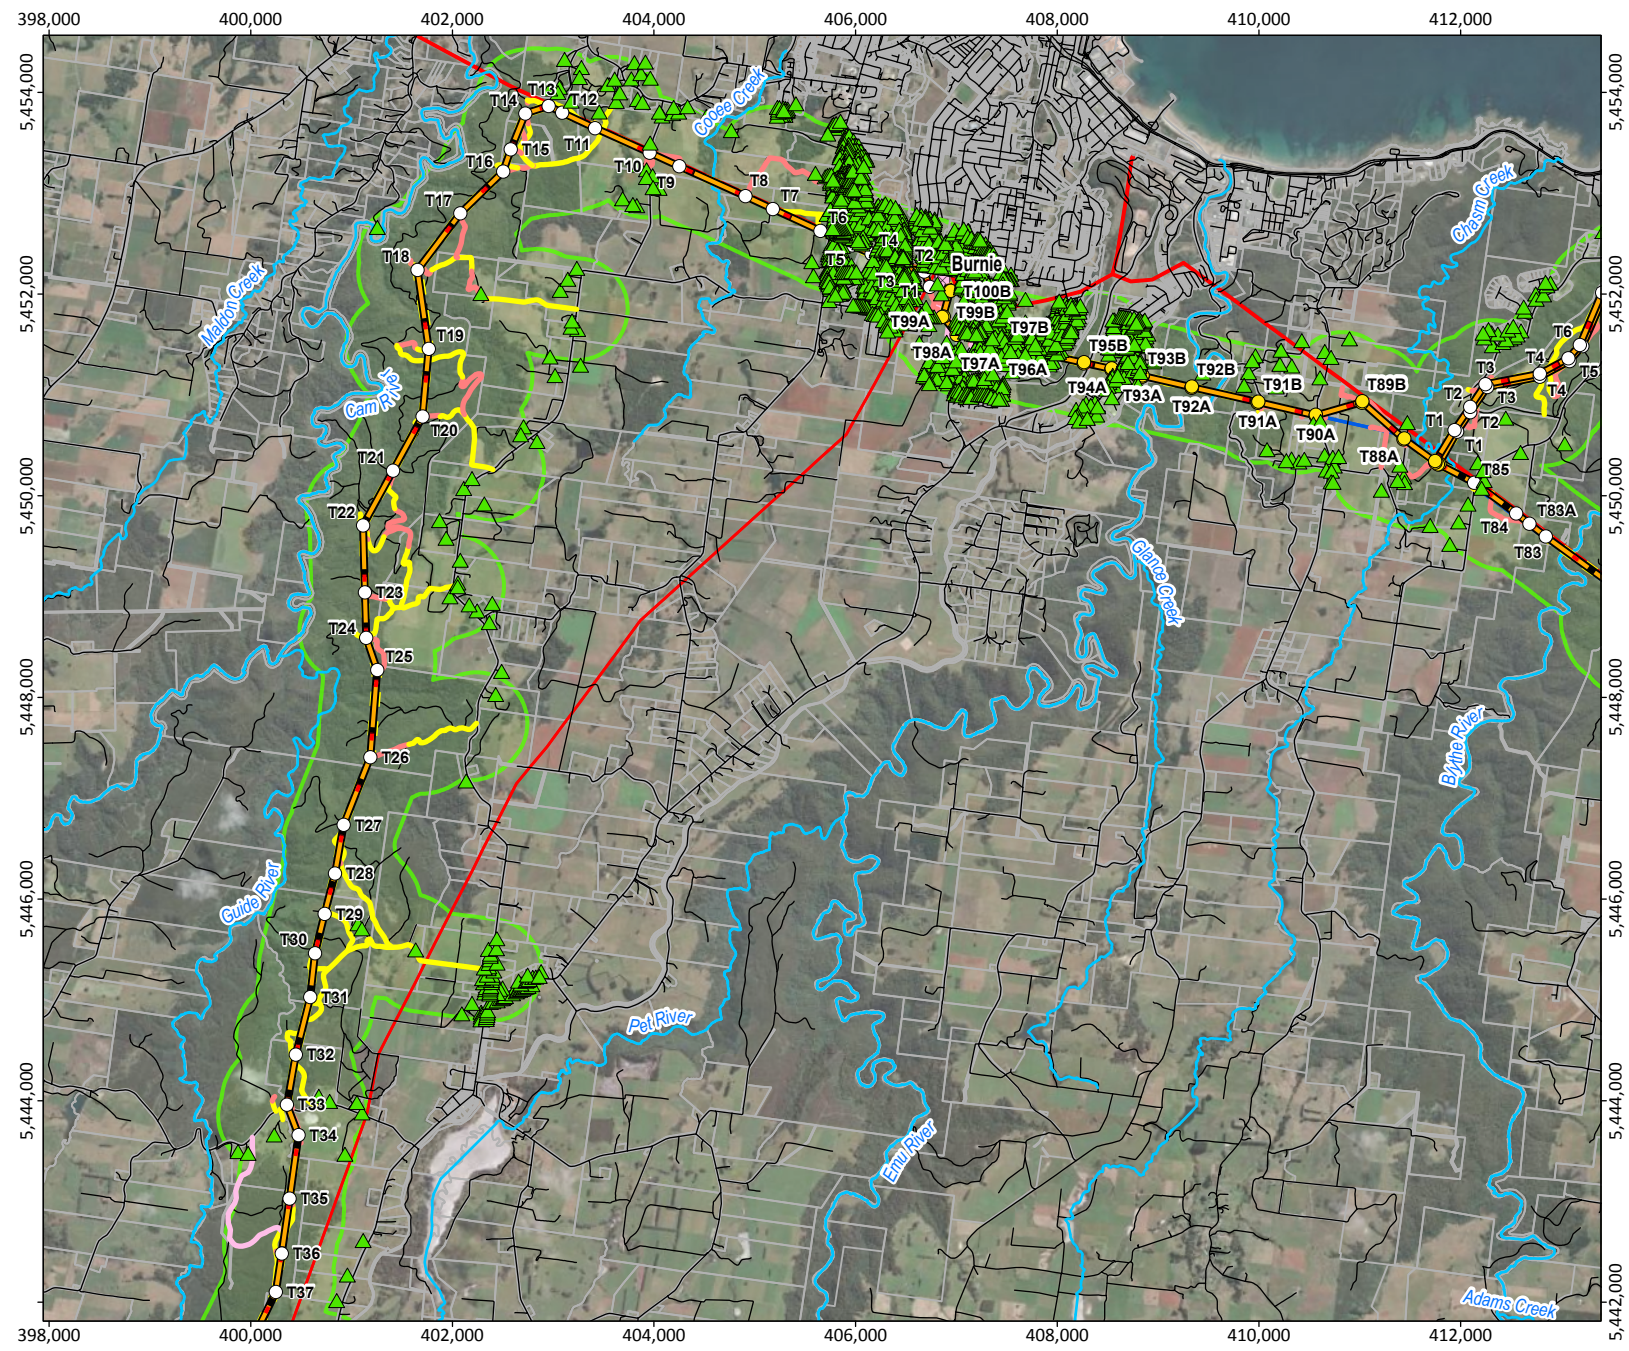


Source: Proposed routes and existing transmission lines from TasNetworks. Receivers from Tetra Tech Coffey. Place names, roads and watercourses from DNRET. Imagery from ESRI Online.
TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2026

- ✕ Existing substation to be modified
- Proposed 220 kV dual monopoles
- Proposed Tower
- + Potential contaminated land sampling location
- Proposed 220 kV OHTL
- Relocated 110 kV OHTL
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- Road
- Watercourse

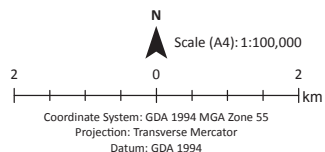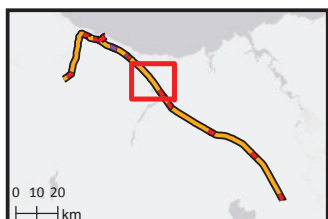

Date: 6/01/2026 10:24 AM
Prepared by: Tetra Tech Coffey

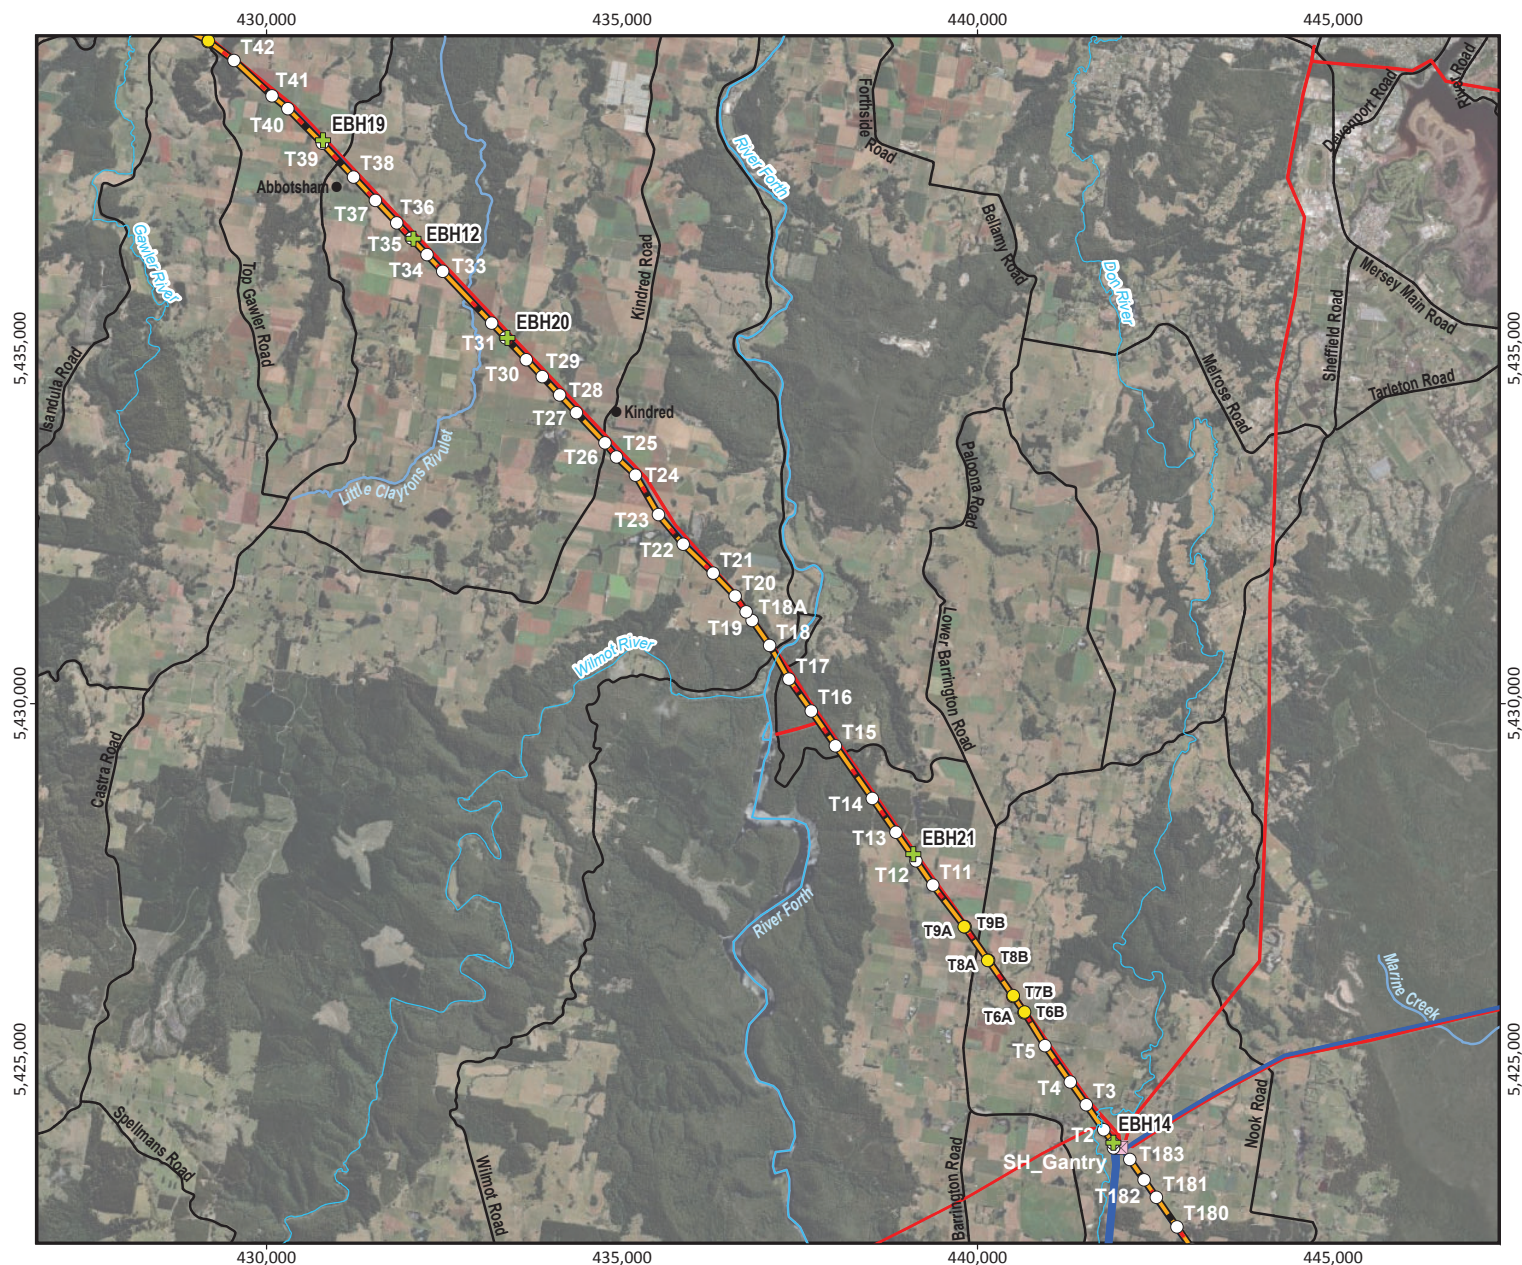



Source: Proposed routes and existing transmission lines from TasNetworks. Sampling locations from Pitt and Sherry. Place names, roads and watercourses from DPIPW. Imagery from ESRI Online.

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.


© TasNetworks 2026

Legend

- ✕ Existing substation to be modified
- Other switching station/substation*
- Proposed 220 kV dual monopoles
- Proposed Tower
- + Potential contaminated land sampling location
- Proposed 220 kV OHTL
- Relocated 110 kV OHTL
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- Road
- Watercourse

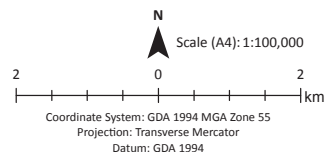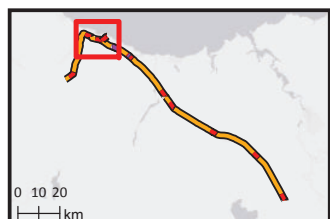

Date: 6/01/2026 10:24 AM
Prepared by: Tetra Tech Coffey

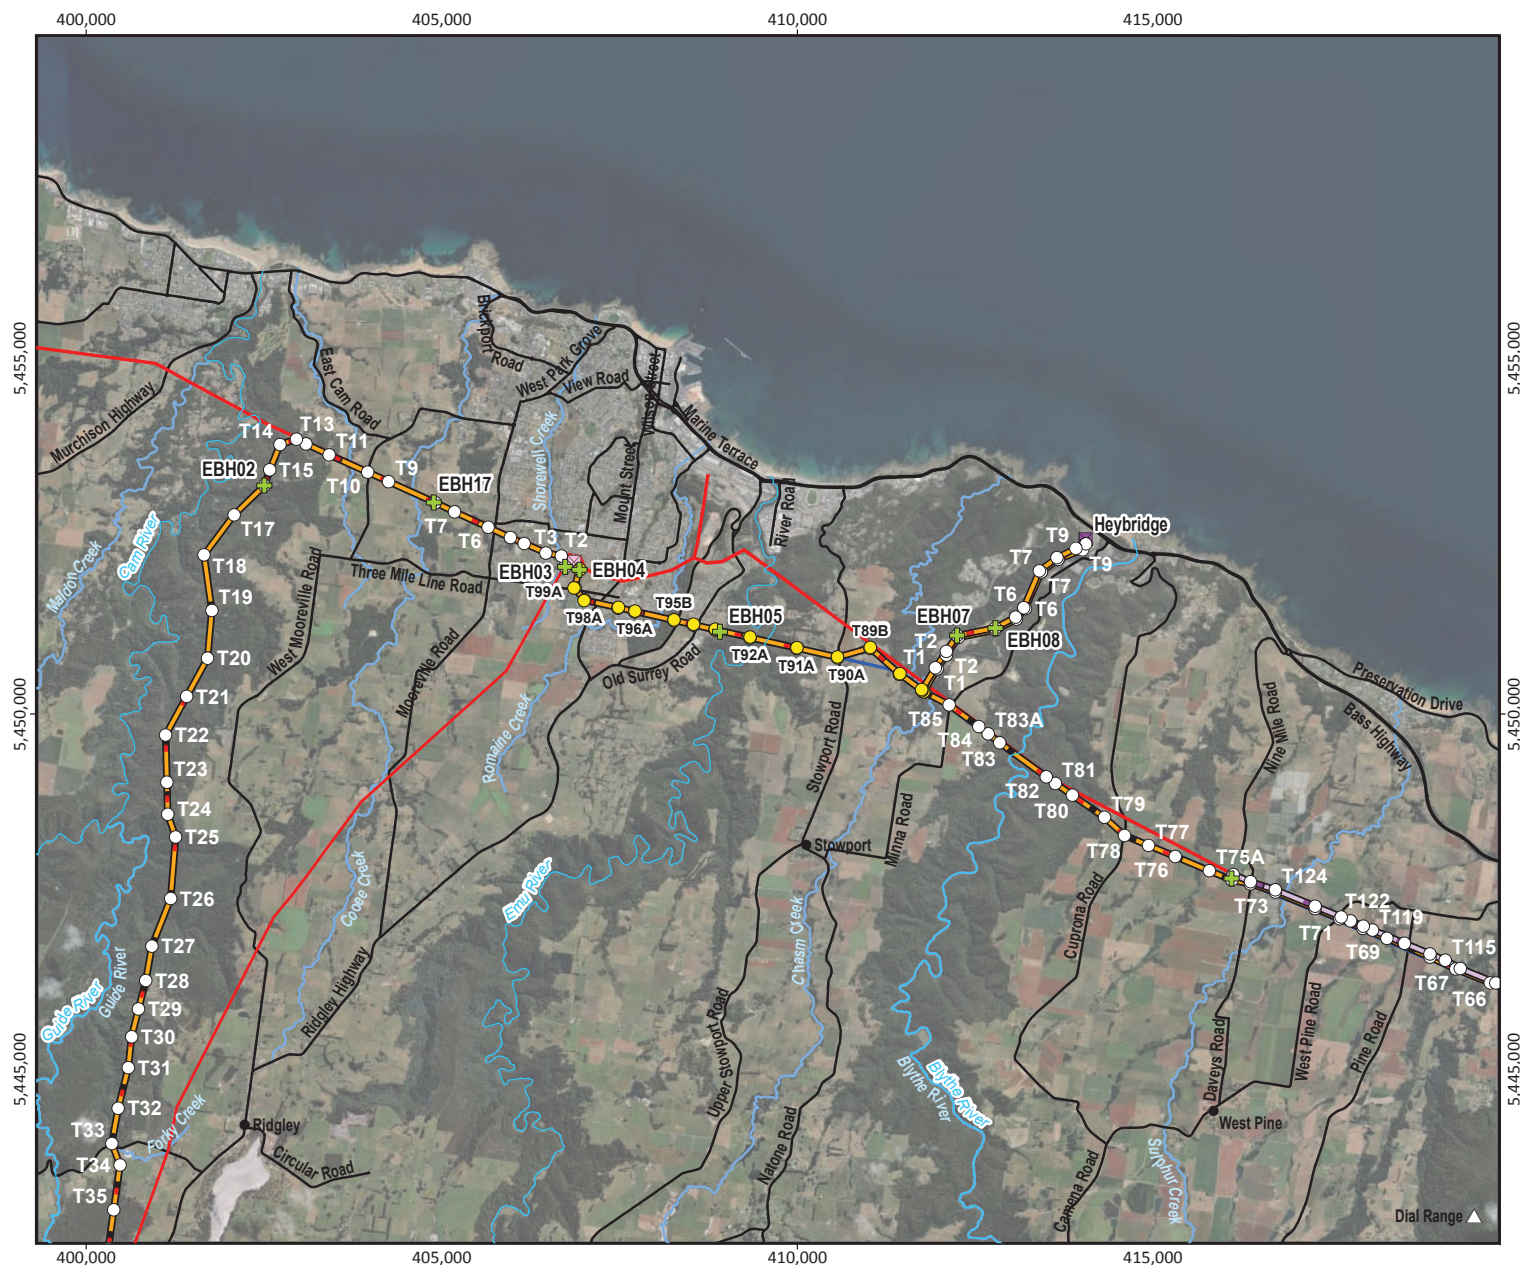



Source: Proposed routes and existing transmission lines from TasNetworks. Sampling locations from Pitt and Sherry. Place names, roads and watercourses from DPIWE. Imagery from ESRI Online.

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2026

Figure 9.3
Proposed monitoring
locations (map 4 of 7)

Legend

- Dust monitoring location
- Proposed 220 kV dual monopole
- Proposed tower
- ▬ Proposed 220 kV OHTL
- ▬ Relocated 110 kV OHTL
- ▬ Existing 220kV OHTL
- ▬ Existing 110kV OHTL
- ▬ Road
- ▬ Watercourse
- ▭ Proposed easement
- ▭ Cadastre

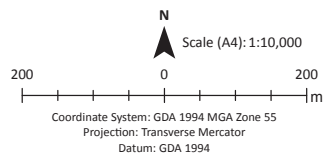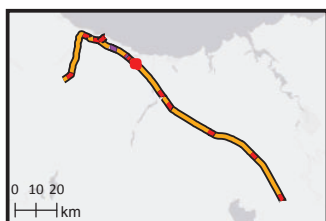

Date: 5/01/2026 10:06 AM
Prepared by: Tetra Tech Coffey



Source: Proposed routes and existing transmission lines from TasNetworks. Place names, roads and watercourses from DPI/PWE. Monitoring locations from Katestone. Imagery from ESRI Online.



TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.

© TasNetworks 2026

Figure 9.3
Proposed monitoring
locations (map 5 of 7)

Legend

- Dust monitoring location
- Proposed 220 kV dual monopole
- Proposed tower
- ▬ Proposed 220 kV OHTL
- ▬ Relocated 110 kV OHTL
- ▬ Existing 220kV OHTL
- ▬ Existing 110kV OHTL
- ▬ Road
- ▬ Watercourse
- ▭ Proposed easement
- ▭ Cadastre

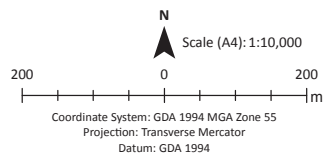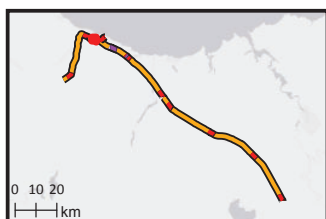

Date: 5/01/2026 10:06 AM
Prepared by: Tetra Tech Coffey



Source: Proposed routes and existing transmission lines from TasNetworks. Place names, roads and watercourses from DPI/PWE. Monitoring locations from Katestone. Imagery from ESRI Online.



TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.

© TasNetworks 2026

Figure 9.3
Proposed monitoring
locations (map 6 of 7)

Legend

-  Dust monitoring location
-  Existing substation to be modified
-  Proposed 220 kV dual monopole
-  Proposed tower
-  Proposed 220 kV OHTL
-  Relocated 110 kV OHTL
-  Existing 220kV OHTL
-  Existing 110kV OHTL
-  Road
-  Watercourse
-  Proposed easement
-  Cadastre

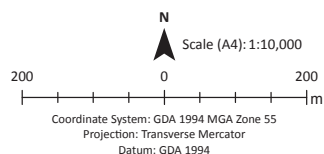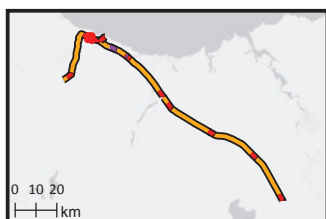

Date: 5/01/2026 10:06 AM
Prepared by: Tetra Tech Coffey



Source: Proposed routes and existing transmission lines from TasNetworks. Place names, roads and watercourses from DPI/PWE. Monitoring locations from Katestone. Imagery from ESRI Online.

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.

© TasNetworks 2026



Attachment 8

Source: Proposed routes from TasNetworks. Vegetation clearance boundaries and envelopes from Tetra Tech Coffey. Place names, roads and watercourses from DPIWPWE. Imagery from ESRI Online.

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.

© TasNetworks 2025

- Proposed tower
- Proposed 220 kV dual monopoles
- ▬ Proposed 220 kV OHTL
- ▬ Relocated 110 kV OHTL
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- ▭ NWTD adjoining parcels boundary
- ▭ NWTD site boundary

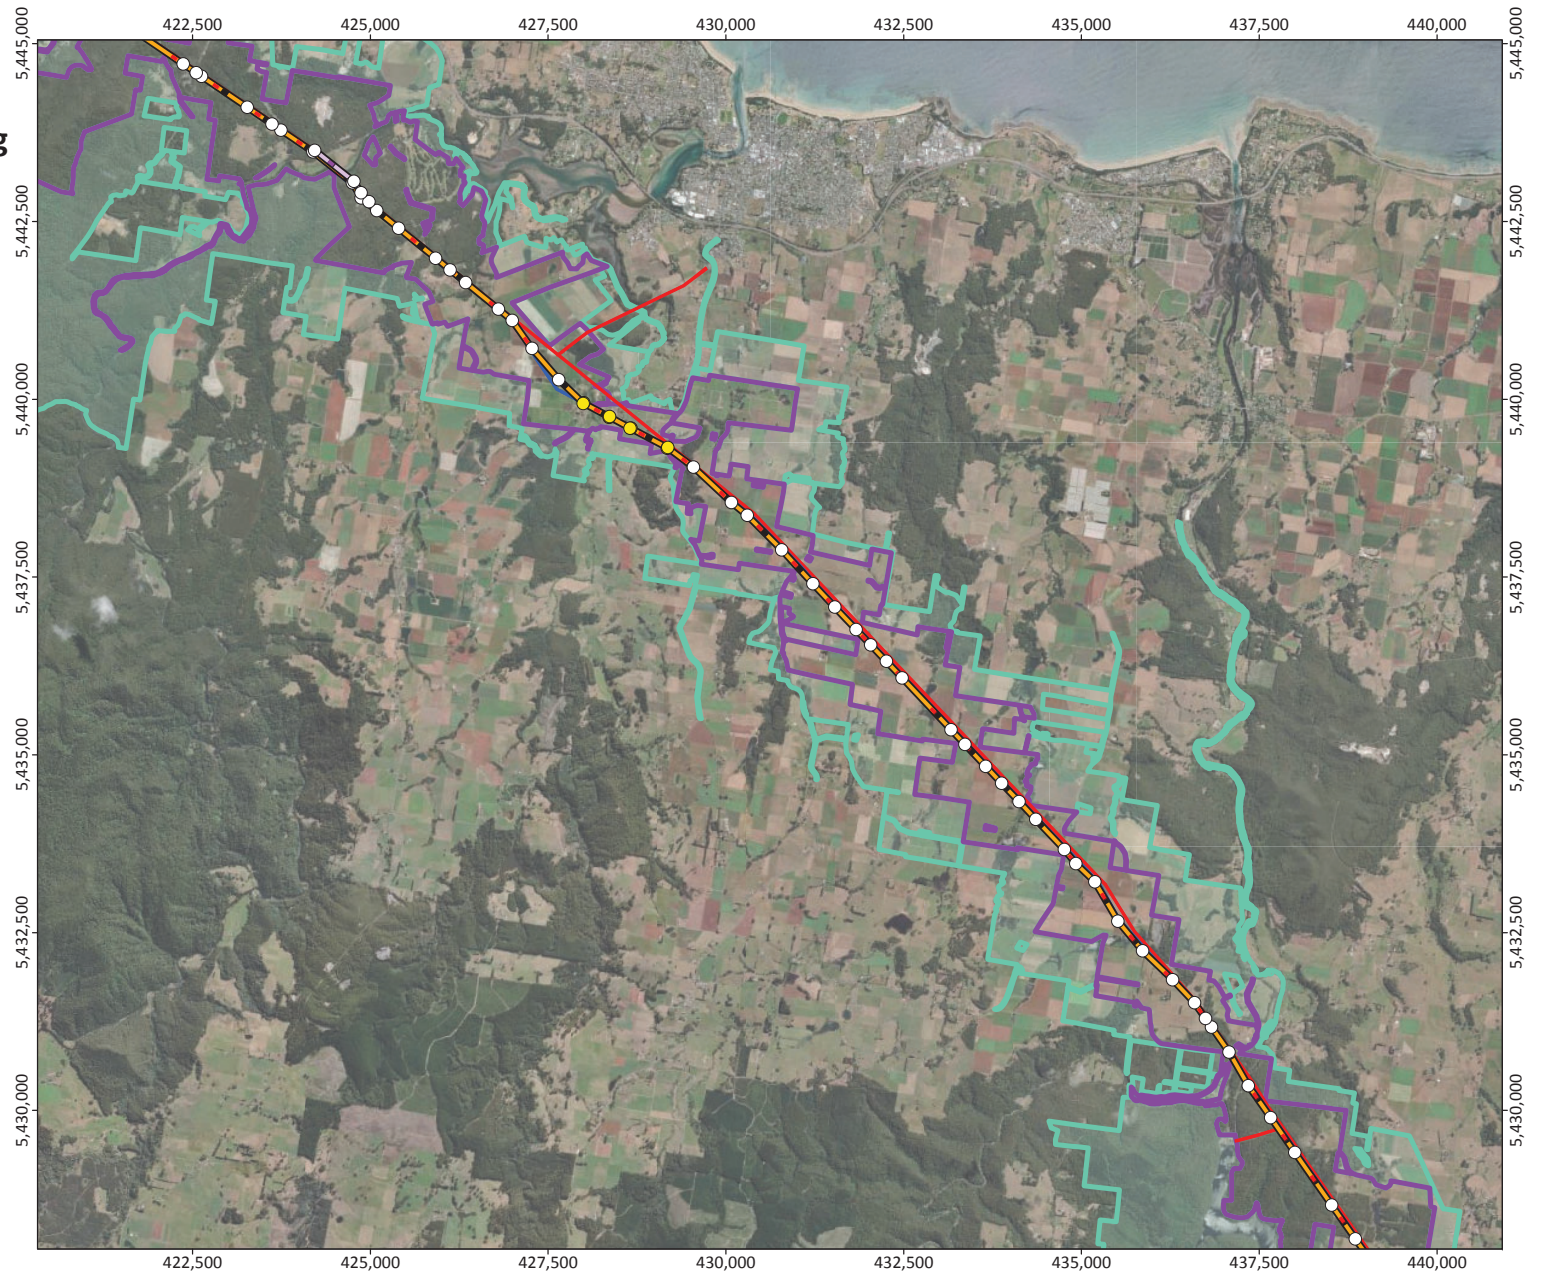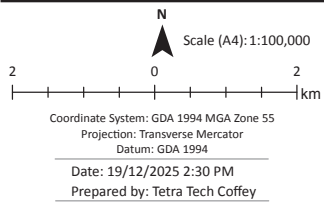


Source: Proposed routes from TasNetworks. Vegetation clearance boundaries and envelopes from Tetra Tech Coffey. Place names, roads and watercourses from DPIWPWE. Imagery from ESRI Online.

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.

© TasNetworks 2025

Legend

- Proposed tower
- Proposed 220 kV dual monopoles
- Other switching station/substation*
- ▬ Proposed 220 kV OHTL
- ▬ Relocated 110 kV OHTL
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- ▭ NWTD adjoining parcels boundary
- ▭ NWTD site boundary

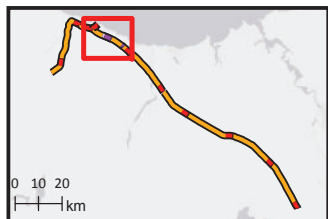

N
▲

Scale (A4): 1:100,000

Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994

Date: 19/12/2025 2:30 PM
Prepared by: Tetra Tech Coffey



Powering a Bright Future



Source: Proposed routes from TasNetworks. Vegetation clearance boundaries and envelopes from Tetra Tech Coffey. Place names, roads and watercourses from DPIWE. Imagery from ESRI Online

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2025

*Heybridge switching

*Heybridge switching station is a new station proposed under a separate project.



Source: Proposed routes from TasNetworks. Vegetation clearance boundaries and envelopes from Tetra Tech Coffey. Place names, roads and watercourses from DPIWPWE. Imagery from ESRI Online.

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.

© TasNetworks 2025


Document Path: \\tt.local\conf\572\GIS\215878 MELEN_TasNetworks Project\Marinus\GIS\MXD_APRX\215878NW_M033_AH8.aprx Layout: 215878NW_M033_F00A8.7 GIS.1

- Proposed tower
- Proposed 220 kV dual monopole
- ▬ Proposed 220 kV OHTL
- ▬ Relocated 110 kV OHTL
- ⊗ Existing tower to be decommissioned
- Existing tower
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- ┌─┐ Proposed easement
- ┌─┐ Existing easement
- ⋮ Notified corridor
- Proposed access tracks
- New track
- Existing, upgrade required (private)
- Existing, upgrade required (public road)

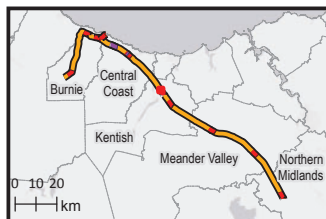

Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994

Date: 19/12/2025 1:56 PM
Prepared by: Tetra Tech Coffey

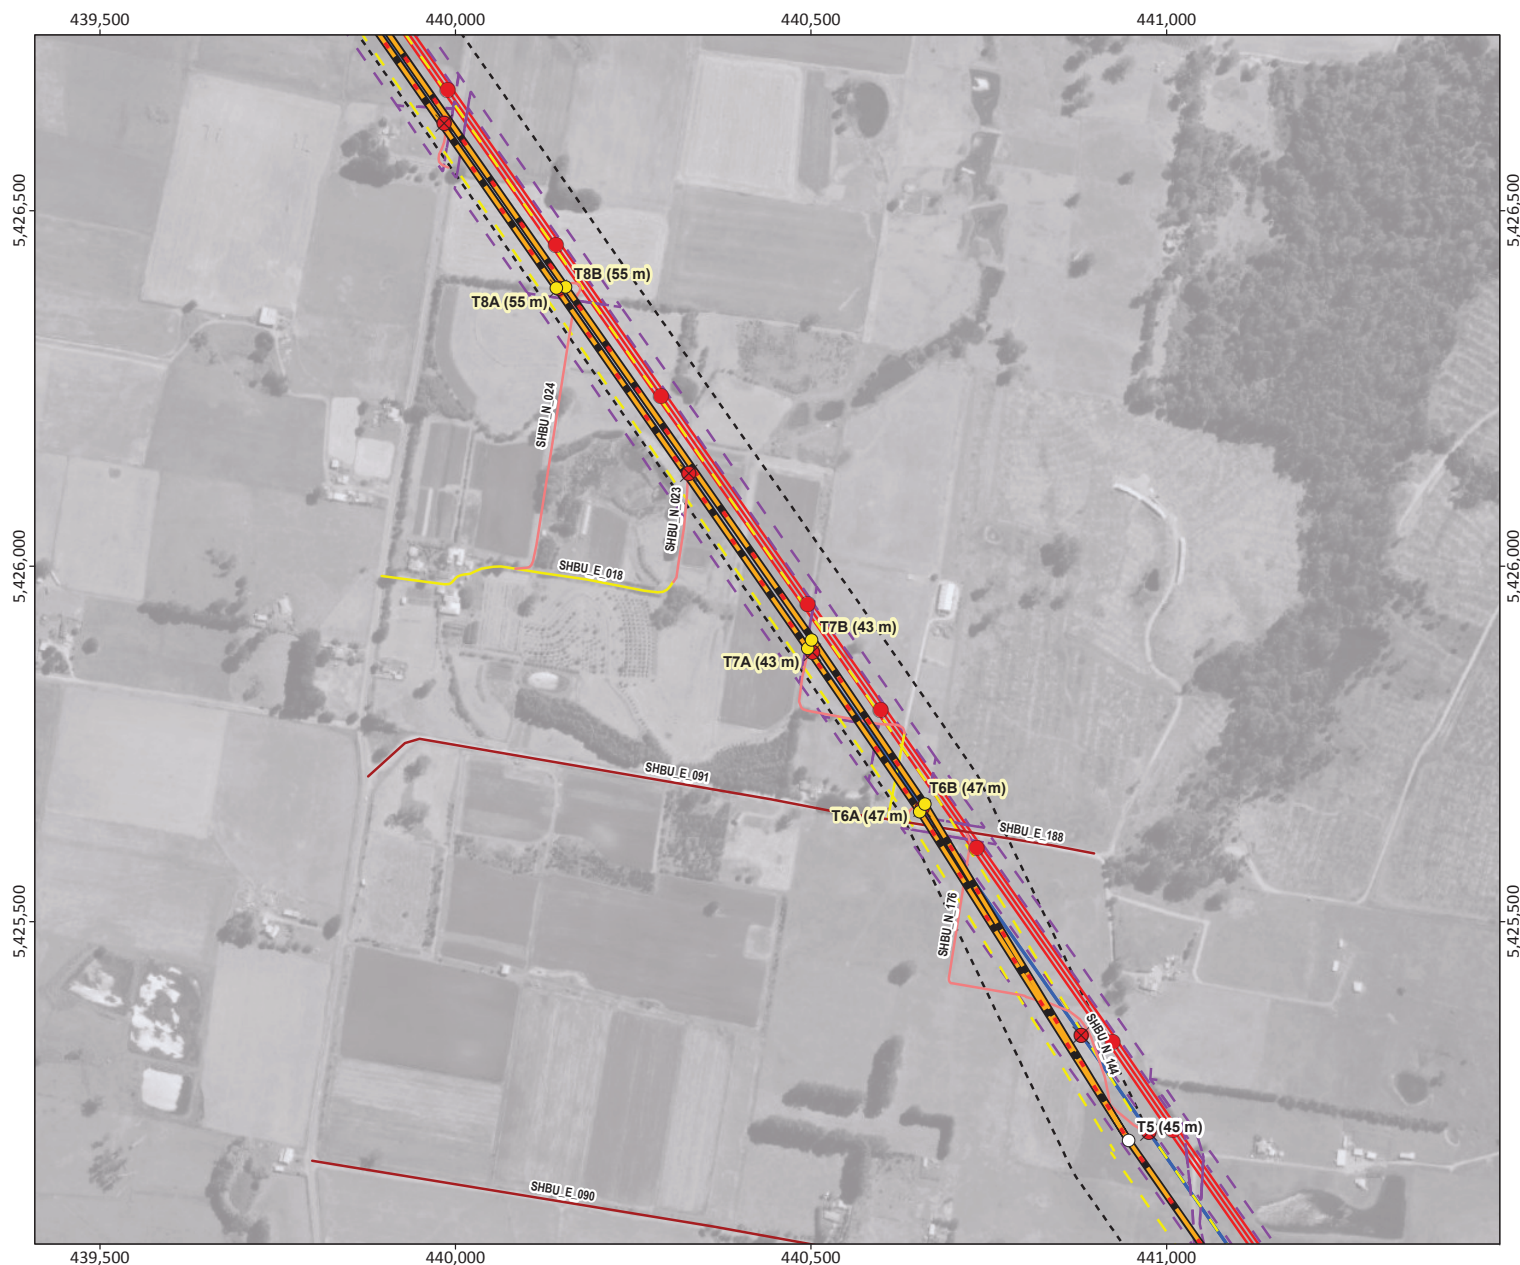


Source: Proposed routes from TasNetworks. Place names, roads and watercourses from DPIPW. Imagery from ESRI Online.

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2025





Powering a
Bright Future



Overhead transmission line site plans – existing and proposed infrastructure (map 50 of 82)


Legend

- Proposed tower
- Proposed 220 kV dual monopole
- ▣ Winch drum and brake site
- ▤ Proposed 220 kV OHTL
- ▥ Relocated 110 kV OHTL
- ⊗ Existing tower to be decommissioned
- Existing tower
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- ┌─ Proposed easement
- └─ Existing easement
- ⋮⋮⋮ Notified corridor
- Proposed access tracks
- New track
- Existing, upgrade required (private)

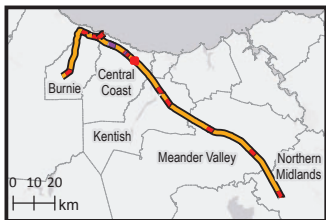

Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994

Date: 19/12/2025 1:56 PM
Prepared by: Tetra Tech Coffey


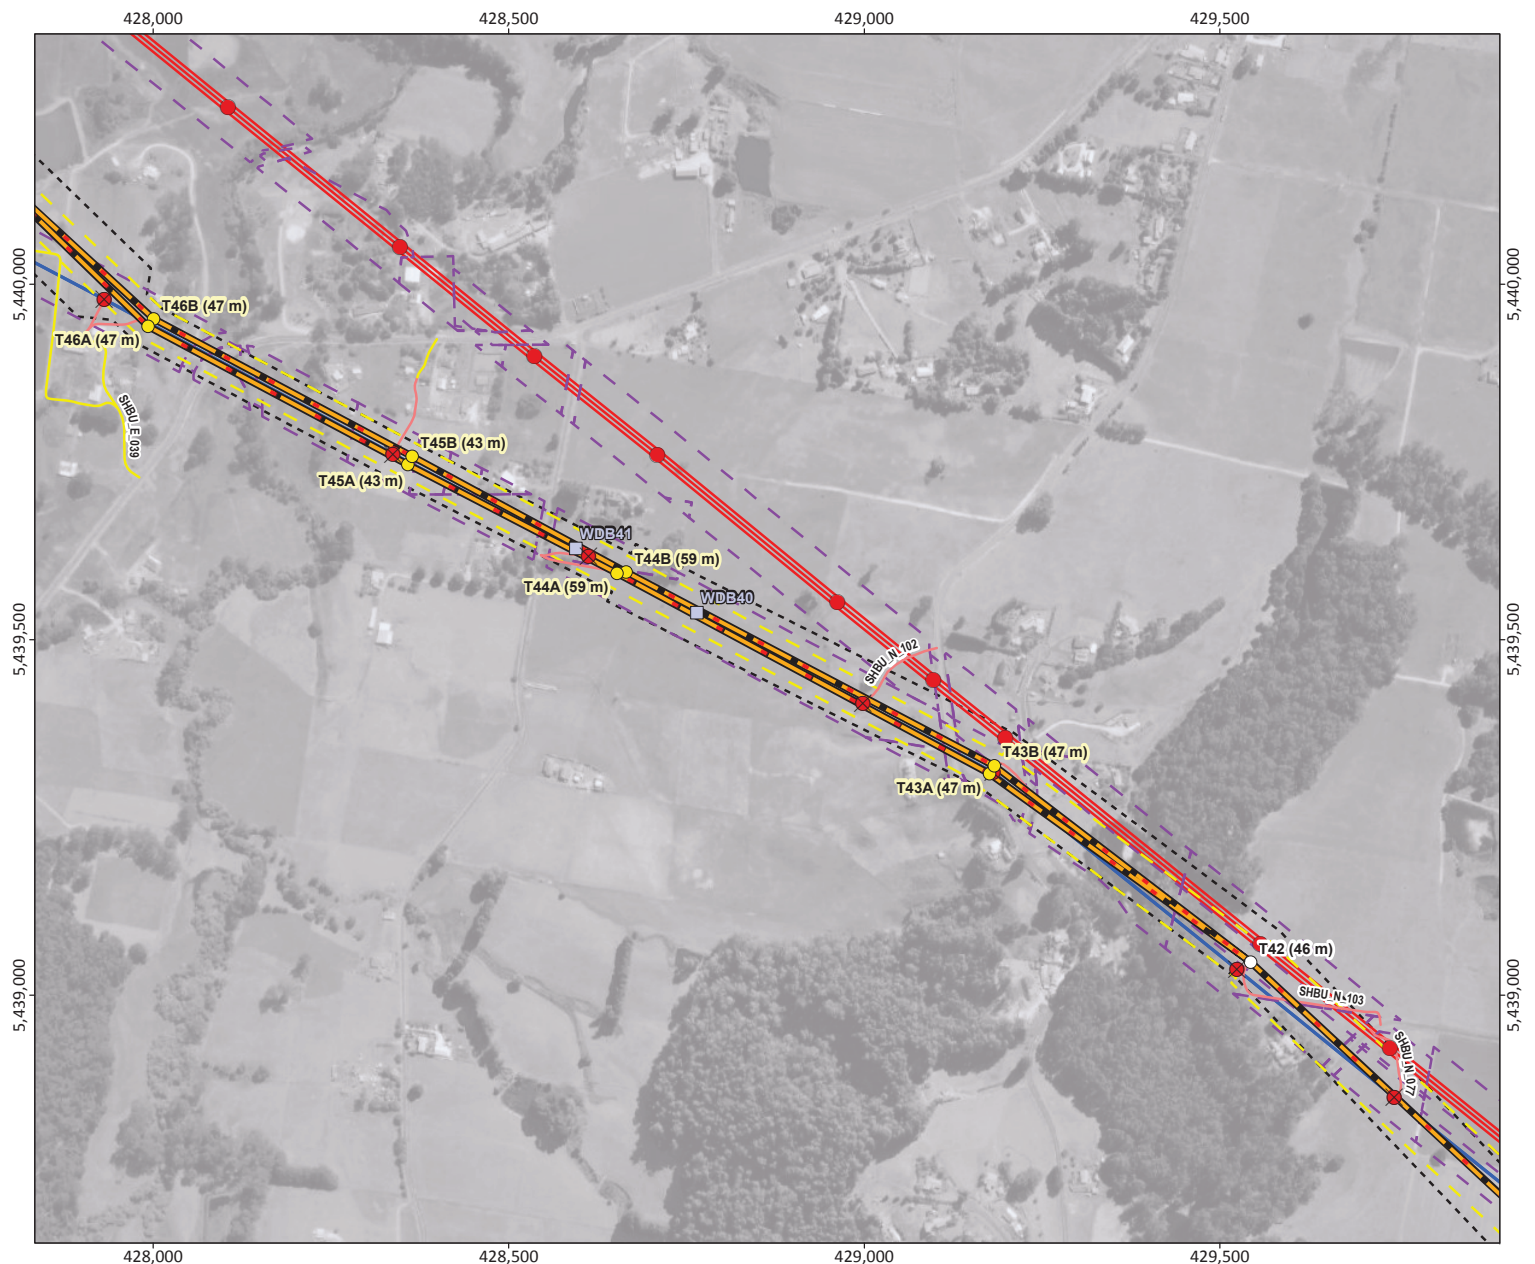


Source: Proposed routes from TasNetworks. Place names, roads and watercourses from DPIPW. Imagery from ESRI Online.

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2025


Document Path: \\tt.local\conf\S772\S\GIS\215878 MELEN_TasNetworks\ProjectMarinus\TasNetworks\ProjectMarinus\GIS\MXD_APRX\215878NW_M033_Att8.aprx Layout: 215878NW_M033_F00A8.7_G1_S.1

- Proposed tower
- Proposed 220 kV dual monopole
- ▬ Proposed 220 kV OHTL
- ▬ Relocated 110 kV OHTL
- ⊗ Existing tower to be decommissioned
- Existing tower
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- ┌─┐ Proposed easement
- ┌─┐ Existing easement
- ⋮⋮⋮ Notified corridor
- Proposed access tracks
- New track
- Existing, upgrade required (private)

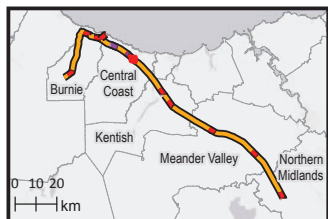

Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994

Date: 19/12/2025 1:56 PM
Prepared by: Tetra Tech Coffey


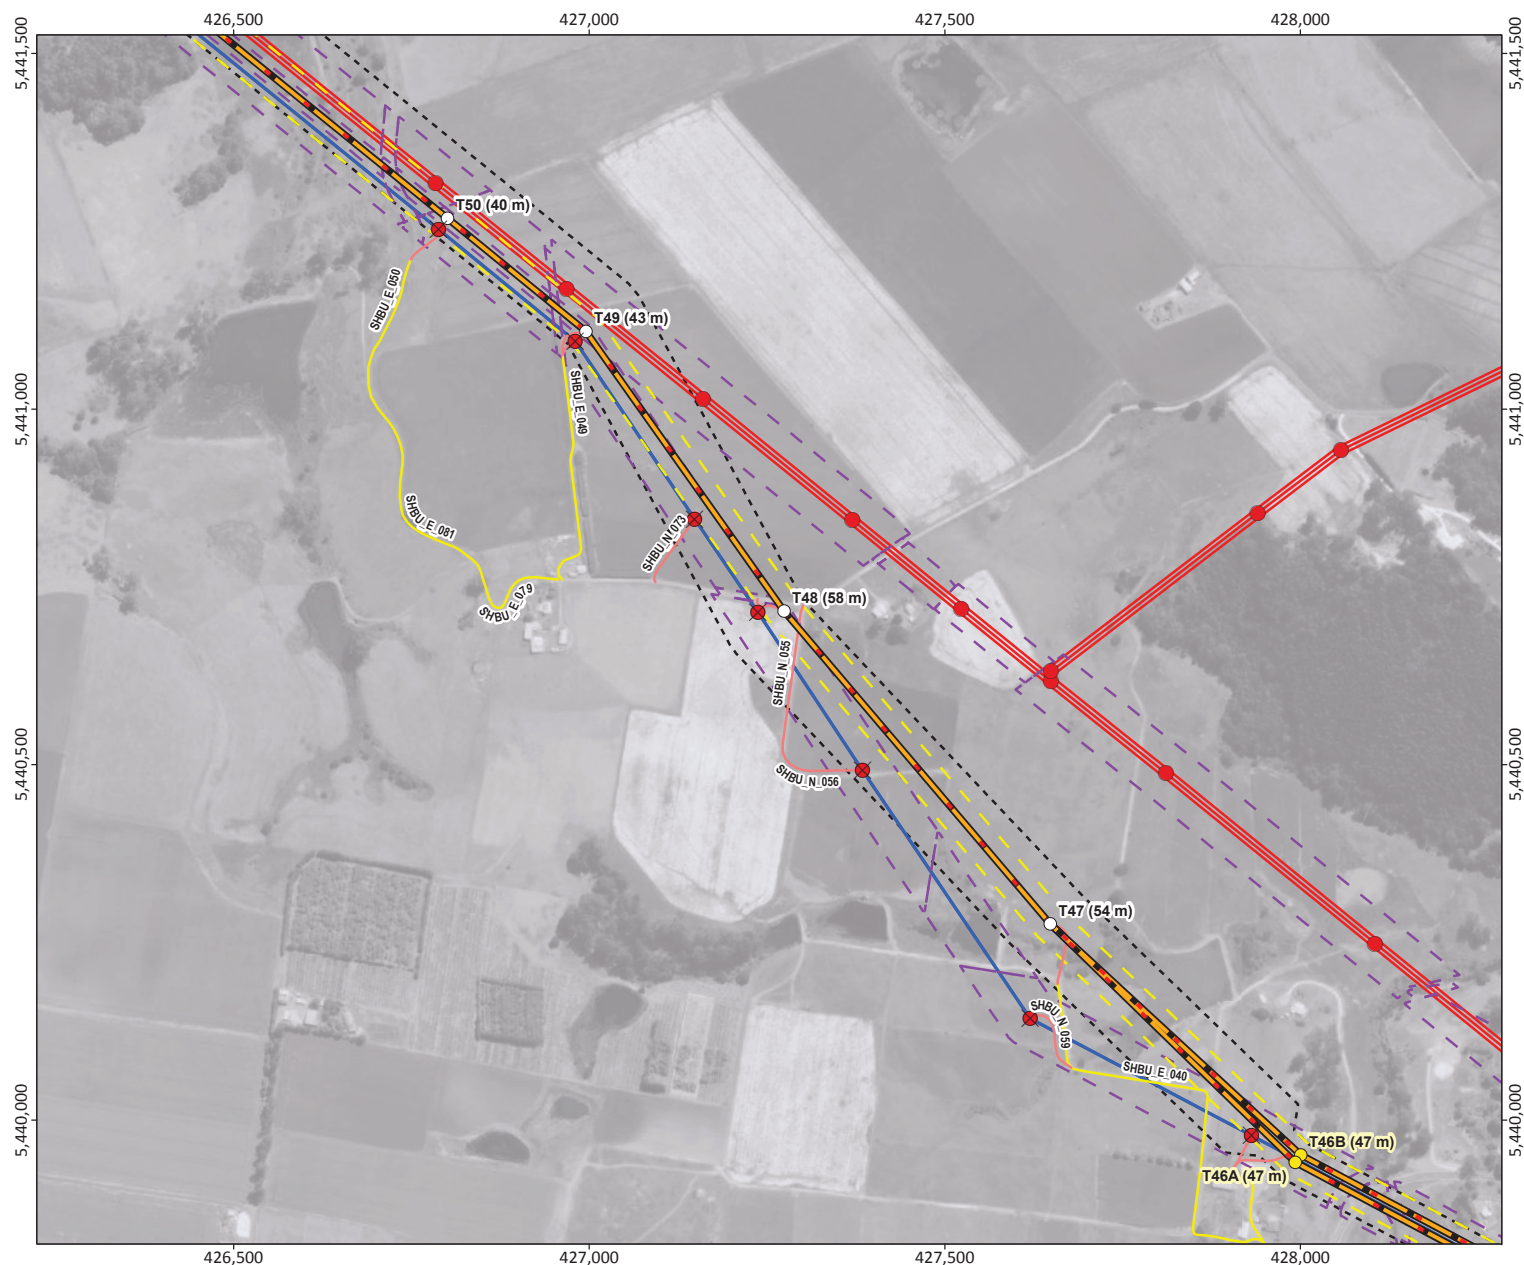


Source: Proposed routes from TasNetworks. Place names, roads and watercourses from DPI/PWE. Imagery from ESRI Online.
TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2025

Figure A8.7
Overhead transmission line
site plans – existing and
proposed infrastructure
(map 55 of 82)


Legend

- Proposed tower
- Proposed 220 kV dual monopole
- Proposed 220 kV OHTL
- Relocated 110 kV OHTL
- ⊗ Existing tower to be decommissioned
- Existing tower
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- Proposed easement
- Existing easement
- ⋯ Notified corridor
- Proposed access tracks
- New track
- Existing, upgrade required (private)

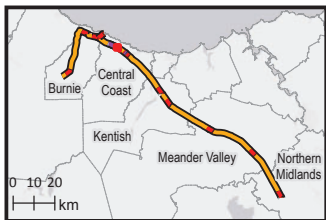

Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994

Date: 19/12/2025 1:56 PM
Prepared by: Tetra Tech Coffey

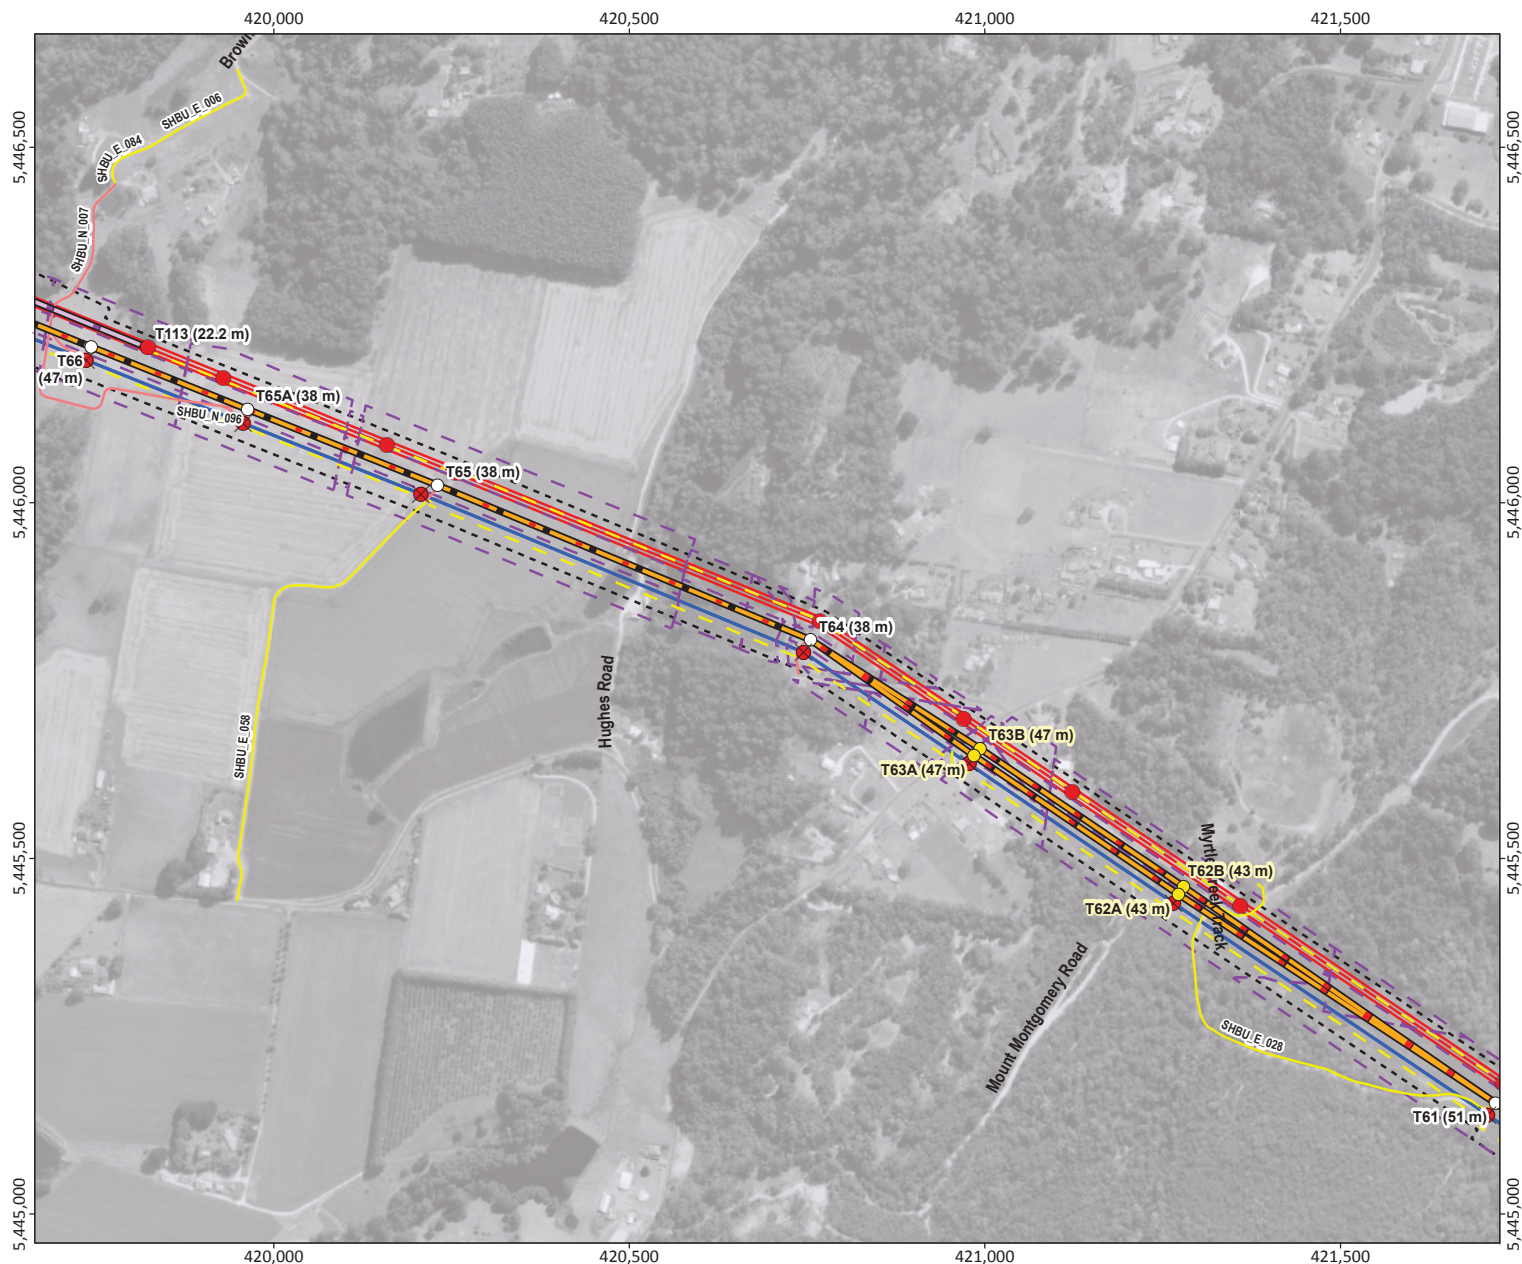




Source: Proposed routes from TasNetworks. Place names, roads and watercourses from DPIPW. Imagery from ESRI Online.

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2025

Overhead transmission line site plans – existing and proposed infrastructure (map 63 of 82)

Legend

- Proposed 220 kV dual monopole
- Winch drum and brake site
- ▬ Proposed 220 kV OHTL
- ▬ Relocated 110 kV OHTL
- ⊗ Existing tower to be decommissioned
- Existing tower
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- ┌─ Proposed easement
- └─ Existing easement
- ⋮ Notified corridor
- Proposed access tracks
- New track
- Existing, upgrade required (private)

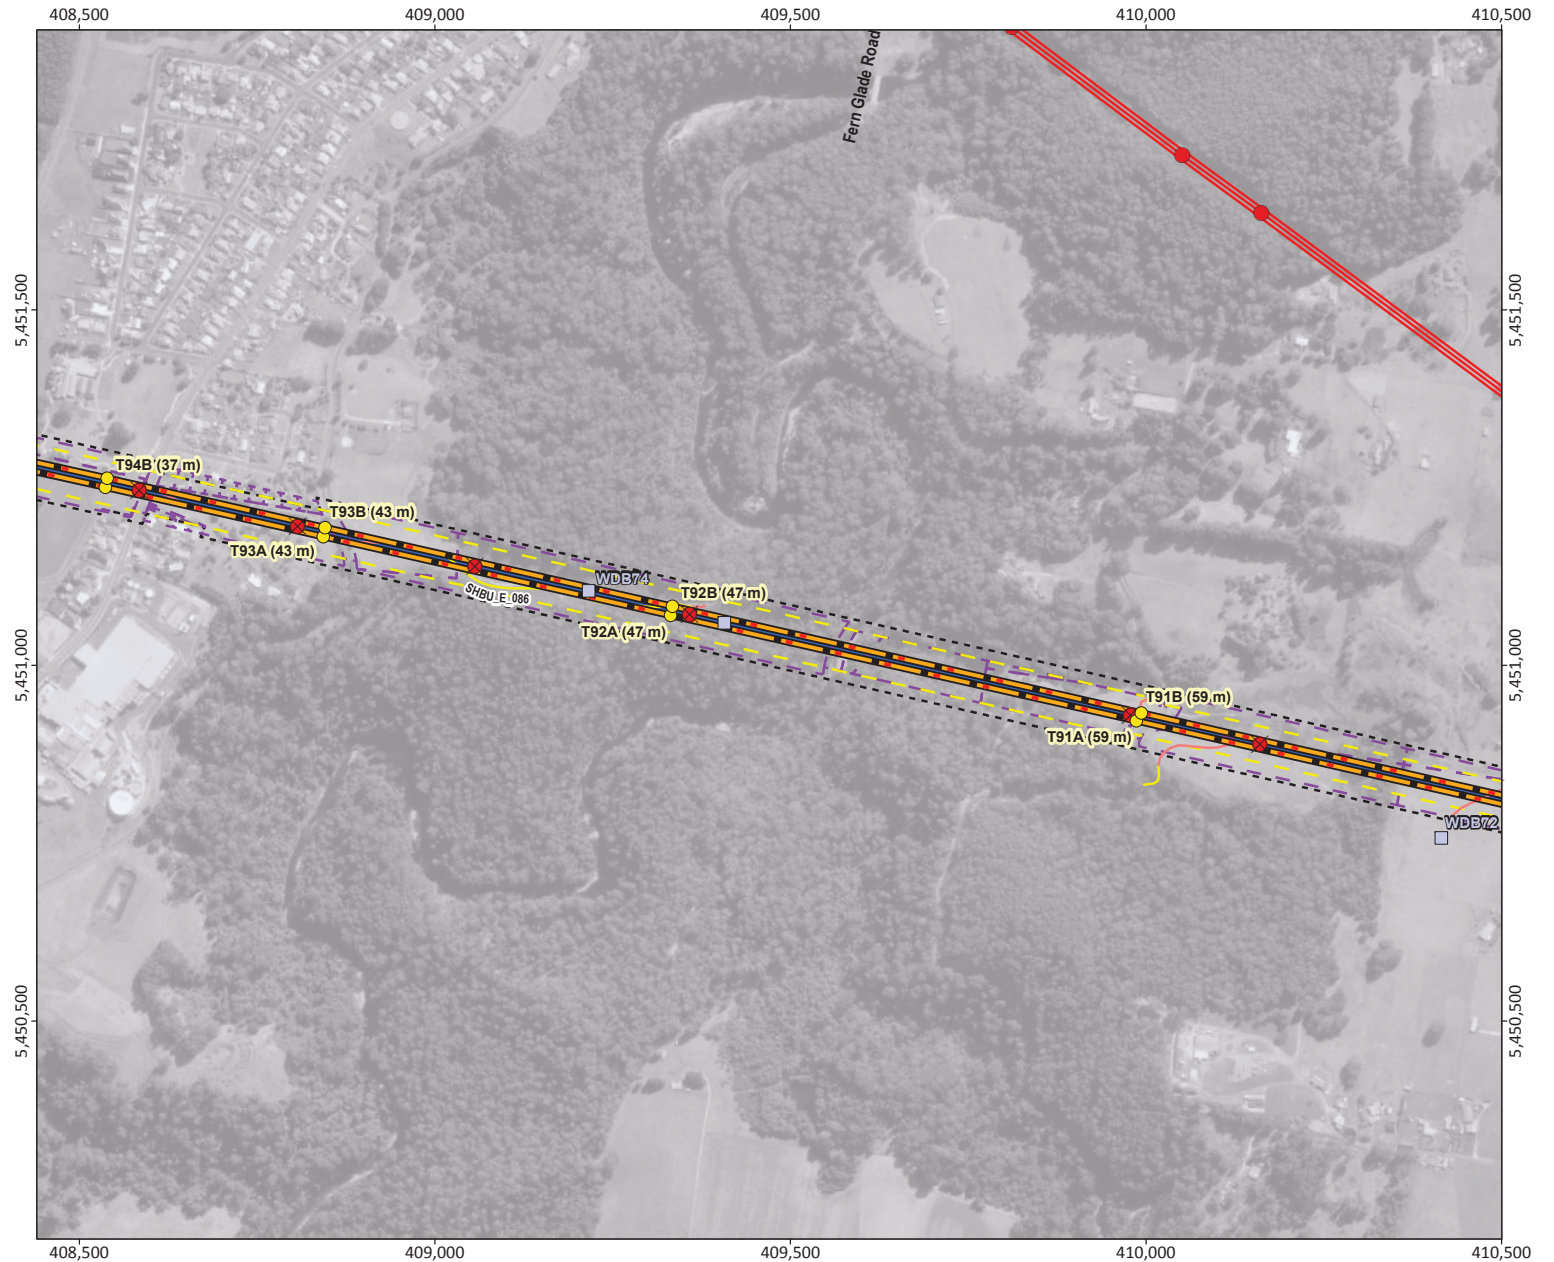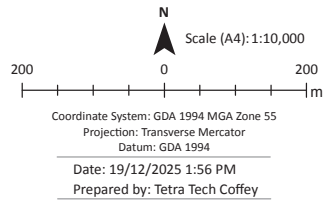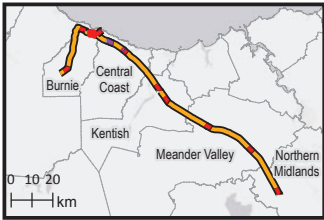


Source: Proposed routes from TasNetworks. Place names, roads and watercourses from DPIPW. Imagery from ESRI Online.

TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2025

Document Path: \\tt.local\cof\5772\S\GIS\215878\NW_M033\215878NW_M033_AHE.aprx Layout: 215878NW_M033_F00A8.7_GS-1

Figure A8.7
Overhead transmission line
site plans – existing and
proposed infrastructure
(map 64 of 82)

- Legend**
- Proposed tower
 - Proposed 220 kV dual monopole
 - ⊠ Existing substation to be modified
 - Winch drum and brake site
 - Proposed 220 kV OHTL
 - Relocated 110 kV OHTL
 - ⊗ Existing tower to be decommissioned
 - Existing tower
 - Existing 110 kV OHTL
 - Existing 220 kV OHTL
 - Proposed easement
 - Existing easement
 - - - Notified corridor
 - Proposed access tracks
 - New track
 - Existing, upgrade required (private)
 - Existing

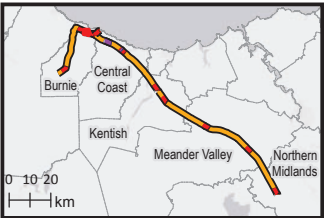


N
Scale (A4): 1:10,000

200 0 200 m

Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994

Date: 19/12/2025 1:56 PM
Prepared by: Tetra Tech Coffey

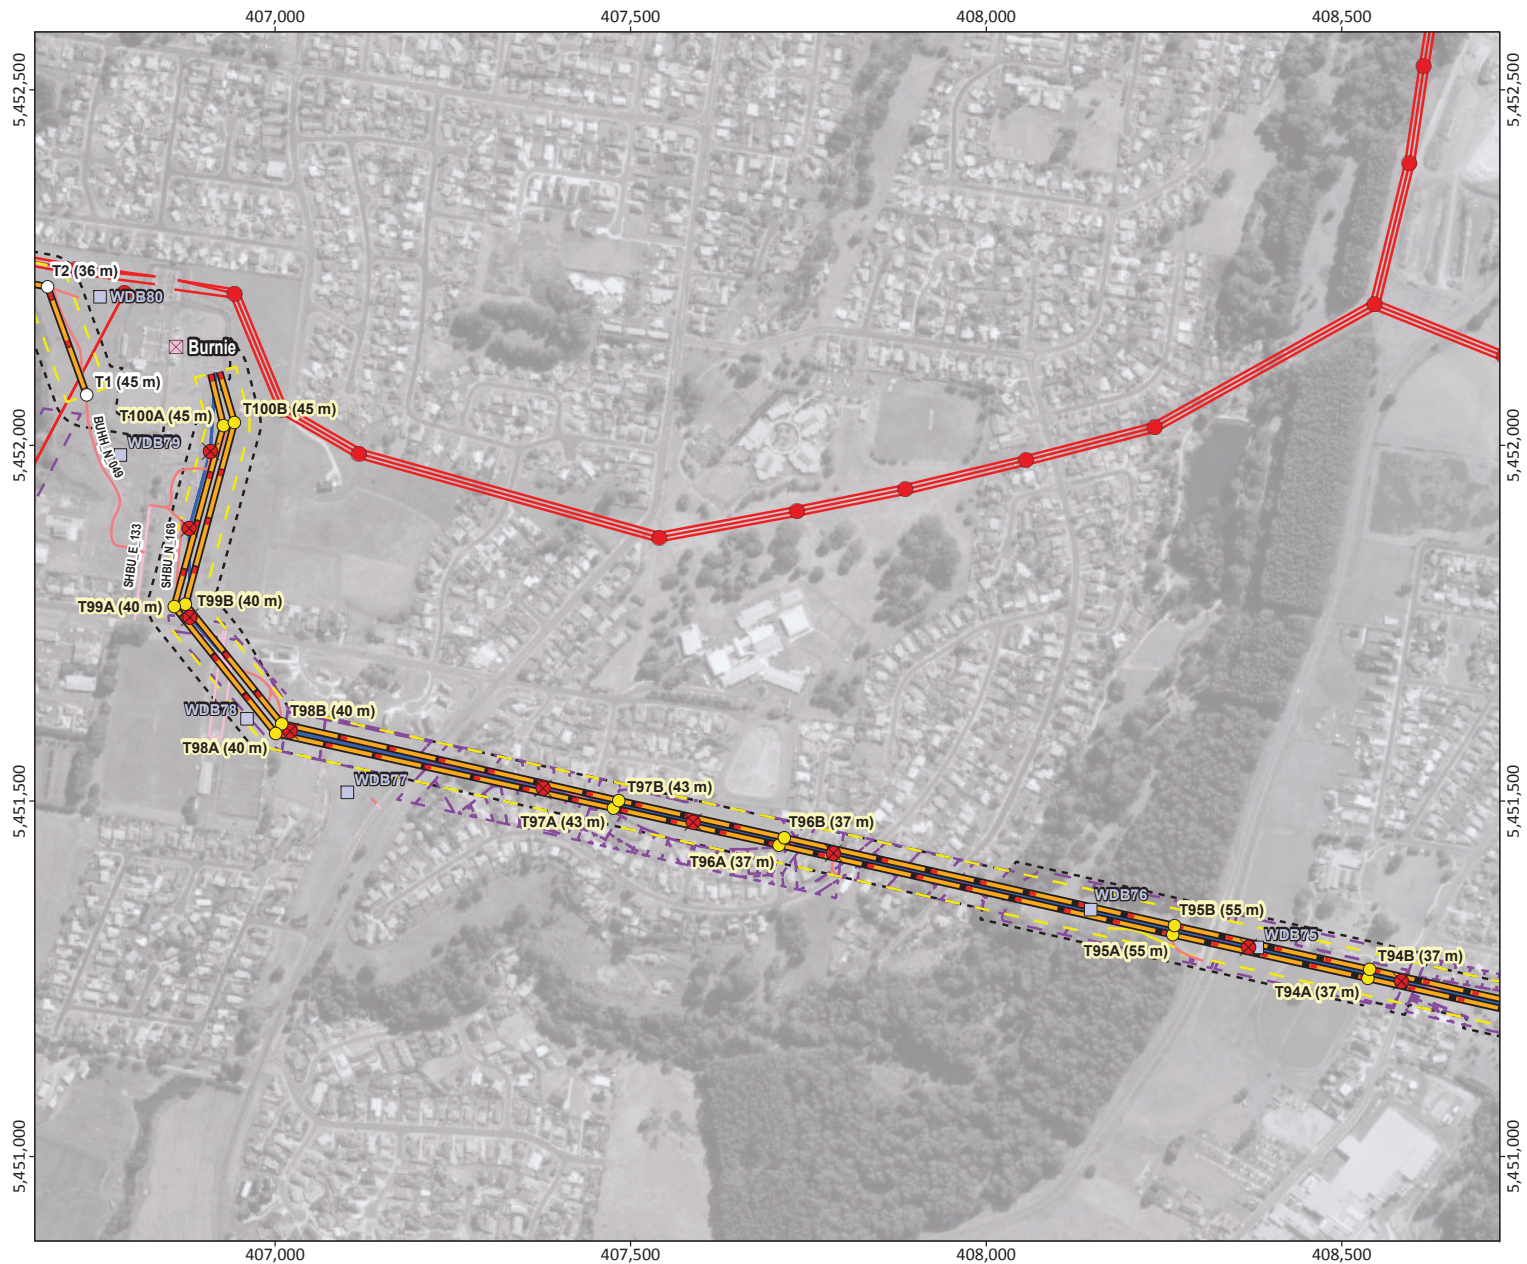


Source: Proposed routes from TasNetworks. Place names, roads and watercourses from DPIPW. Imagery from ESRI Online.
TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2025


Figure A8.8
Overhead transmission line
site plans – project
infrastructure (map 41 of 82)

Legend

- Proposed tower
- Proposed 220 kV dual monopole
- ⊗ Existing tower to be decommissioned
- Existing tower
- Proposed 220 kV OHTL
- Relocated 110 kV OHTL
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- Watercourse
- 10 m contour
- Proposed easement
- Existing easement
- Notified corridor
- Cadastre
- Local Government Area (LGA)

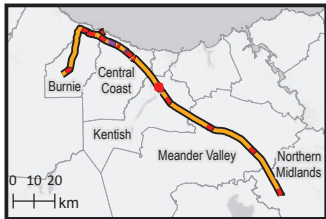

N
Scale (A4): 1:10,000
200 0 200 m
Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994
Date: 19/12/2025 2:30 PM
Prepared by: Tetra Tech Coffey


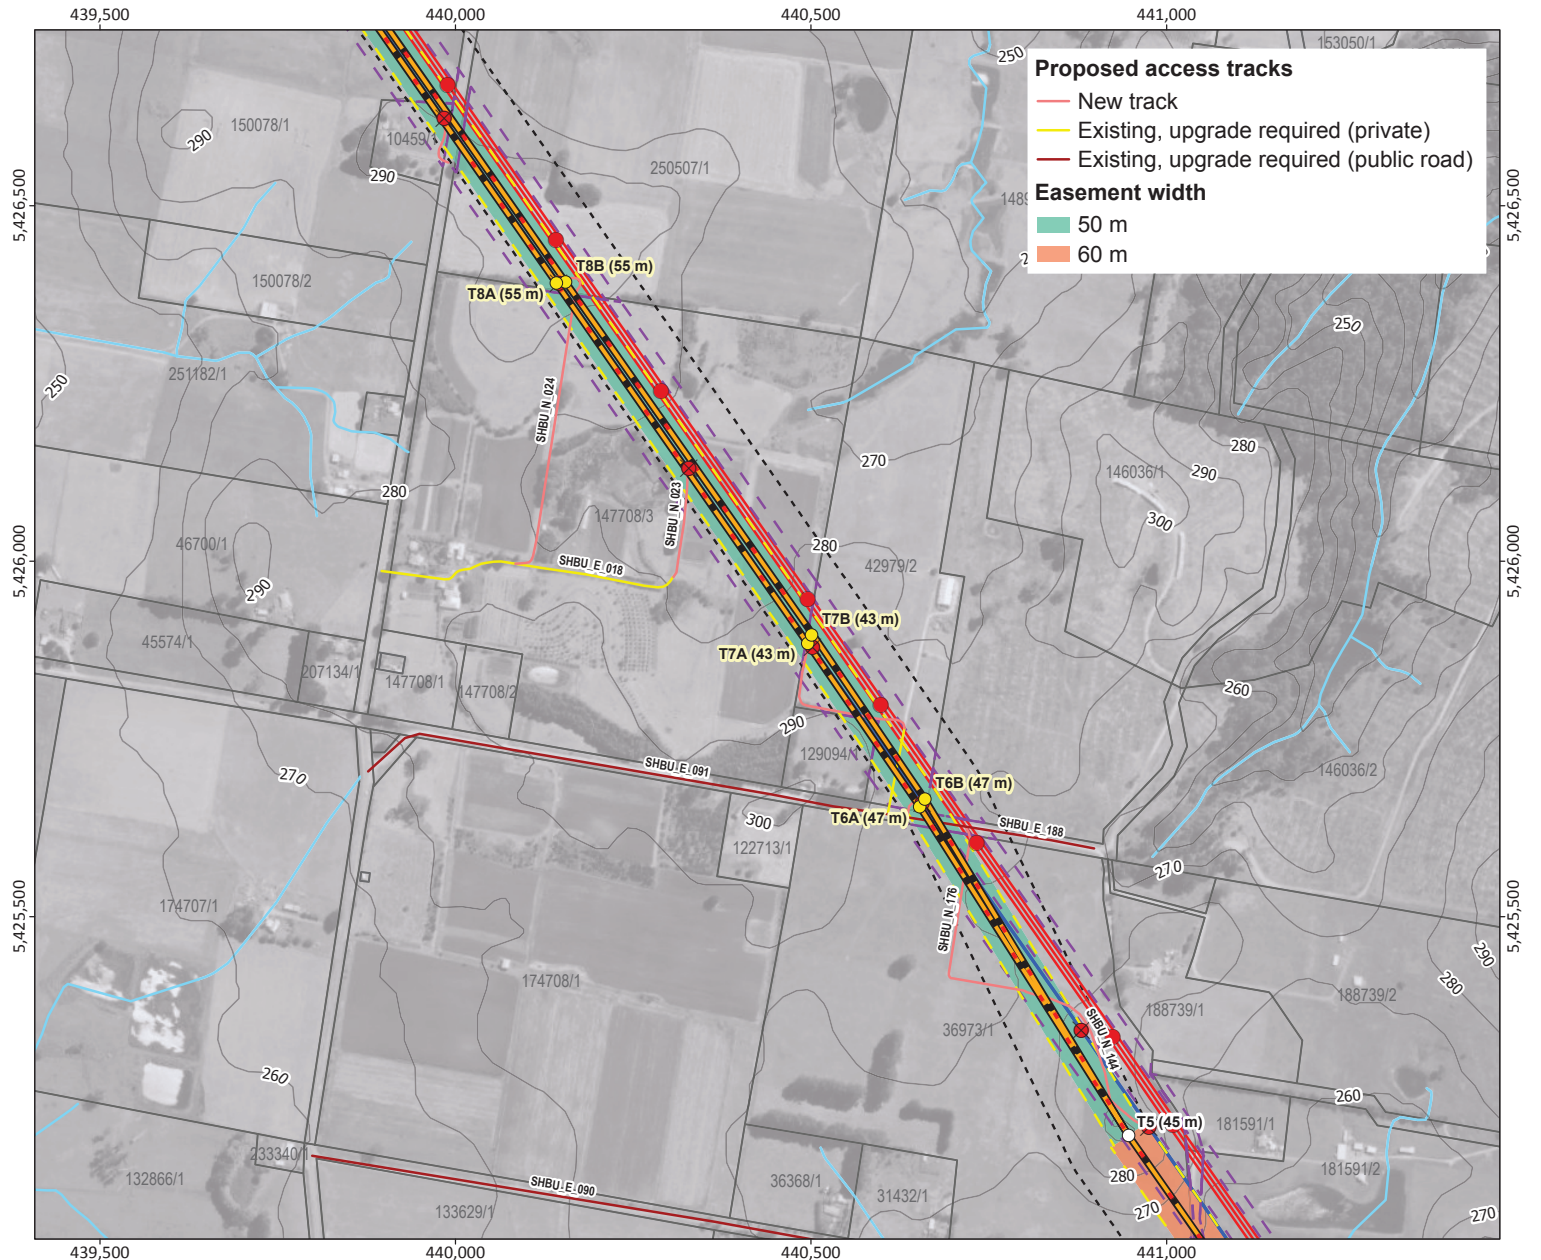


Source: Proposed routes from TasNetworks. Place names, roads, watercourses and LGA boundaries from DPI/PWE. Imagery from ESRI Online.
TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2025

Figure A8.8
Overhead transmission line
site plans – project
infrastructure (map 42 of 82)

Legend

- Proposed tower
- Proposed 220 kV dual monopole
- ✖ Existing tower to be decommissioned
- Existing tower
- Proposed 220 kV OHTL
- Relocated 110 kV OHTL
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- Watercourse
- 10 m contour
- Proposed easement
- Existing easement
- Notified corridor
- Cadastre
- Local Government Area (LGA)

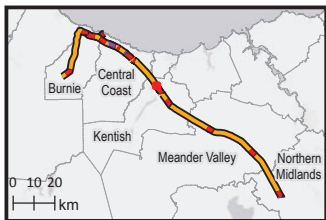

Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994
Date: 19/12/2025 2:30 PM
Prepared by: Tetra Tech Coffey



Proposed access tracks

- New track
- Existing, upgrade required (private)


Easement width

- 50 m
- 60 m

Figure A8.8
Overhead transmission line
site plans – project
infrastructure (map 50 of 82)

Legend

- Proposed tower
- Proposed 220 kV dual monopole
- Winch drum and brake site
- ⊗ Existing tower to be decommissioned
- Existing tower
- Proposed 220 kV OHTL
- Relocated 110 kV OHTL
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- Watercourse
- 10 m contour
- Proposed easement
- Existing easement
- Notified corridor
- Cadastre
- Local Government Area (LGA)

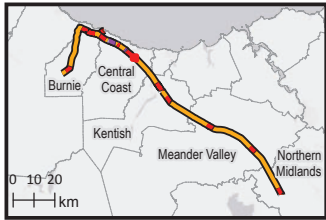

N
Scale (A4): 1:10,000
Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994
Date: 19/12/2025 2:30 PM
Prepared by: Tetra Tech Coffey



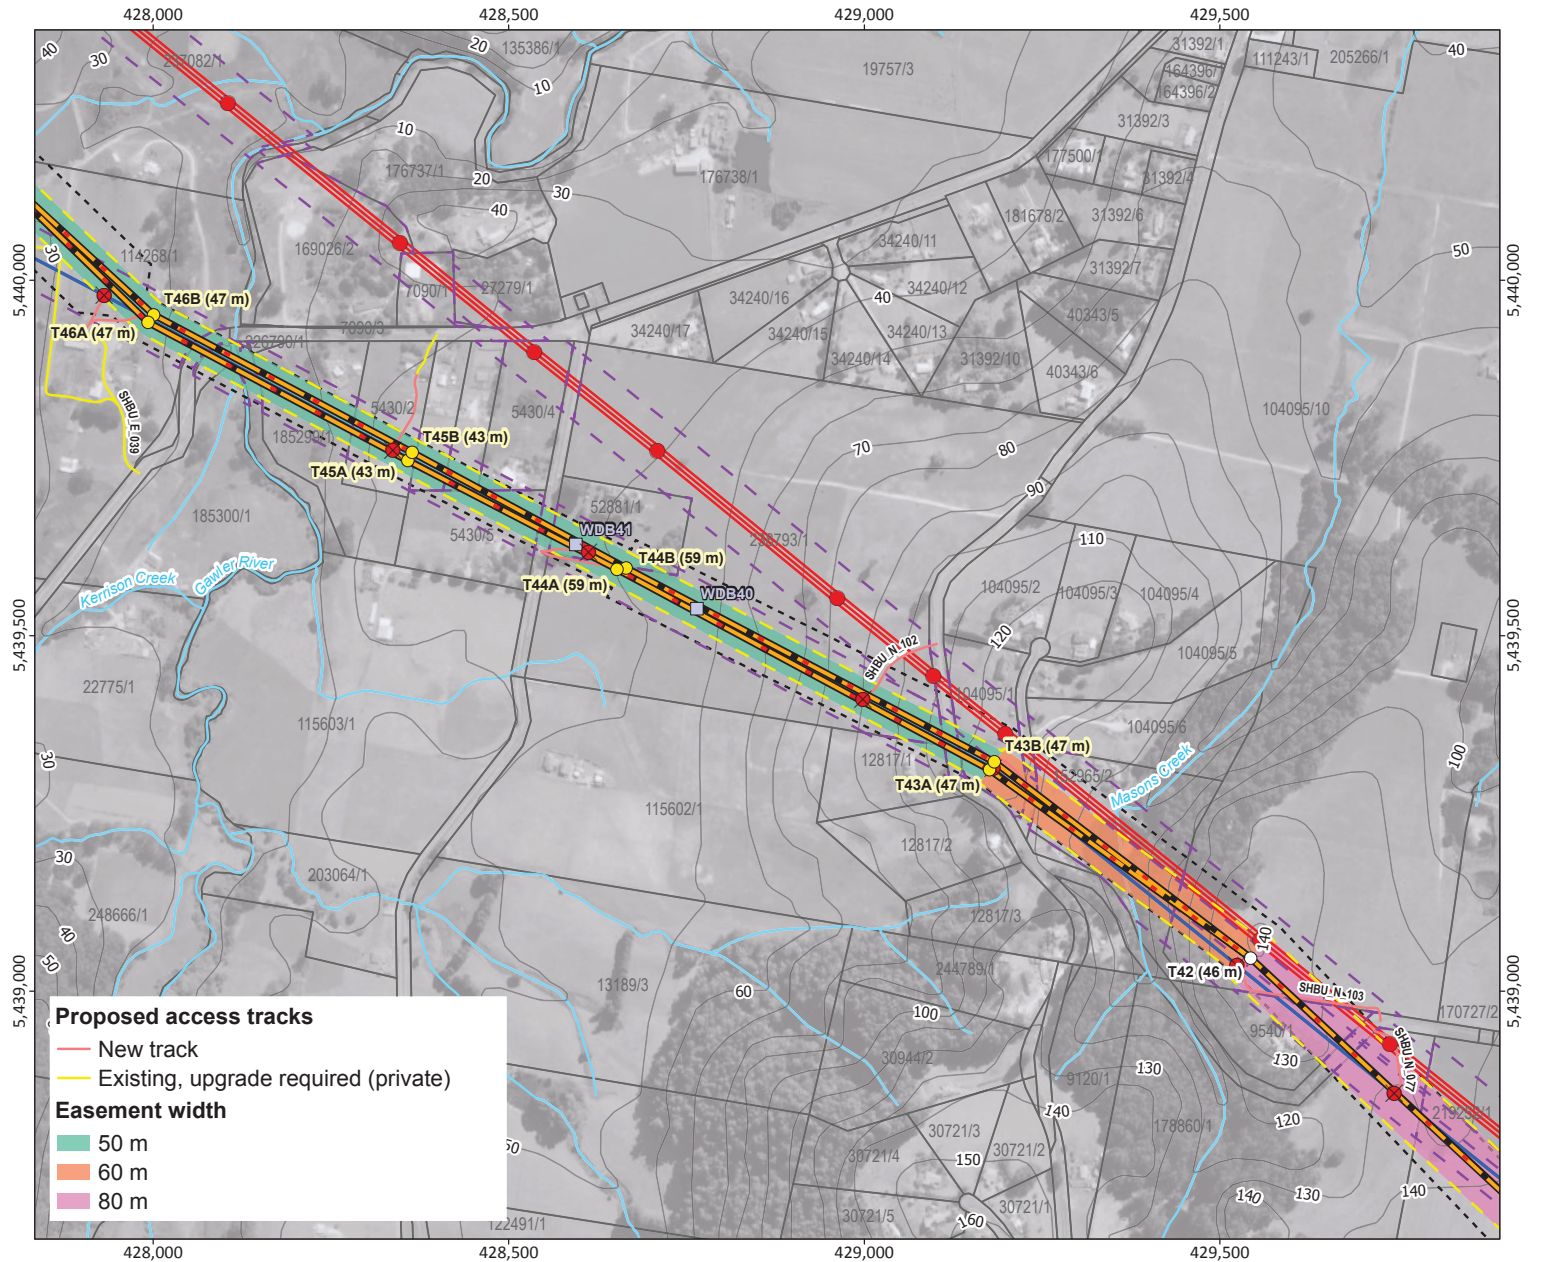


Figure A8.8
Overhead transmission line
site plans – project
infrastructure (map 51 of 82)


Legend

- Proposed tower
- Proposed 220 kV dual monopole
- ⊗ Existing tower to be decommissioned
- Existing tower
- Proposed 220 kV OHTL
- Relocated 110 kV OHTL
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- Watercourse
- 10 m contour
- Proposed easement
- Existing easement
- ⋯ Notified corridor
- ▭ Cadastre
- ▭ Local Government Area (LGA)

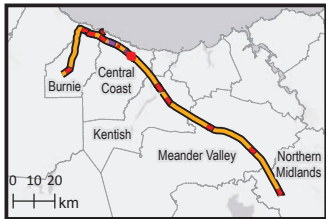

Coordinate System: GDA 1994 MGA Zone 55
Projection: Transverse Mercator
Datum: GDA 1994

Date: 19/12/2025 2:30 PM
Prepared by: Tetra Tech Coffey


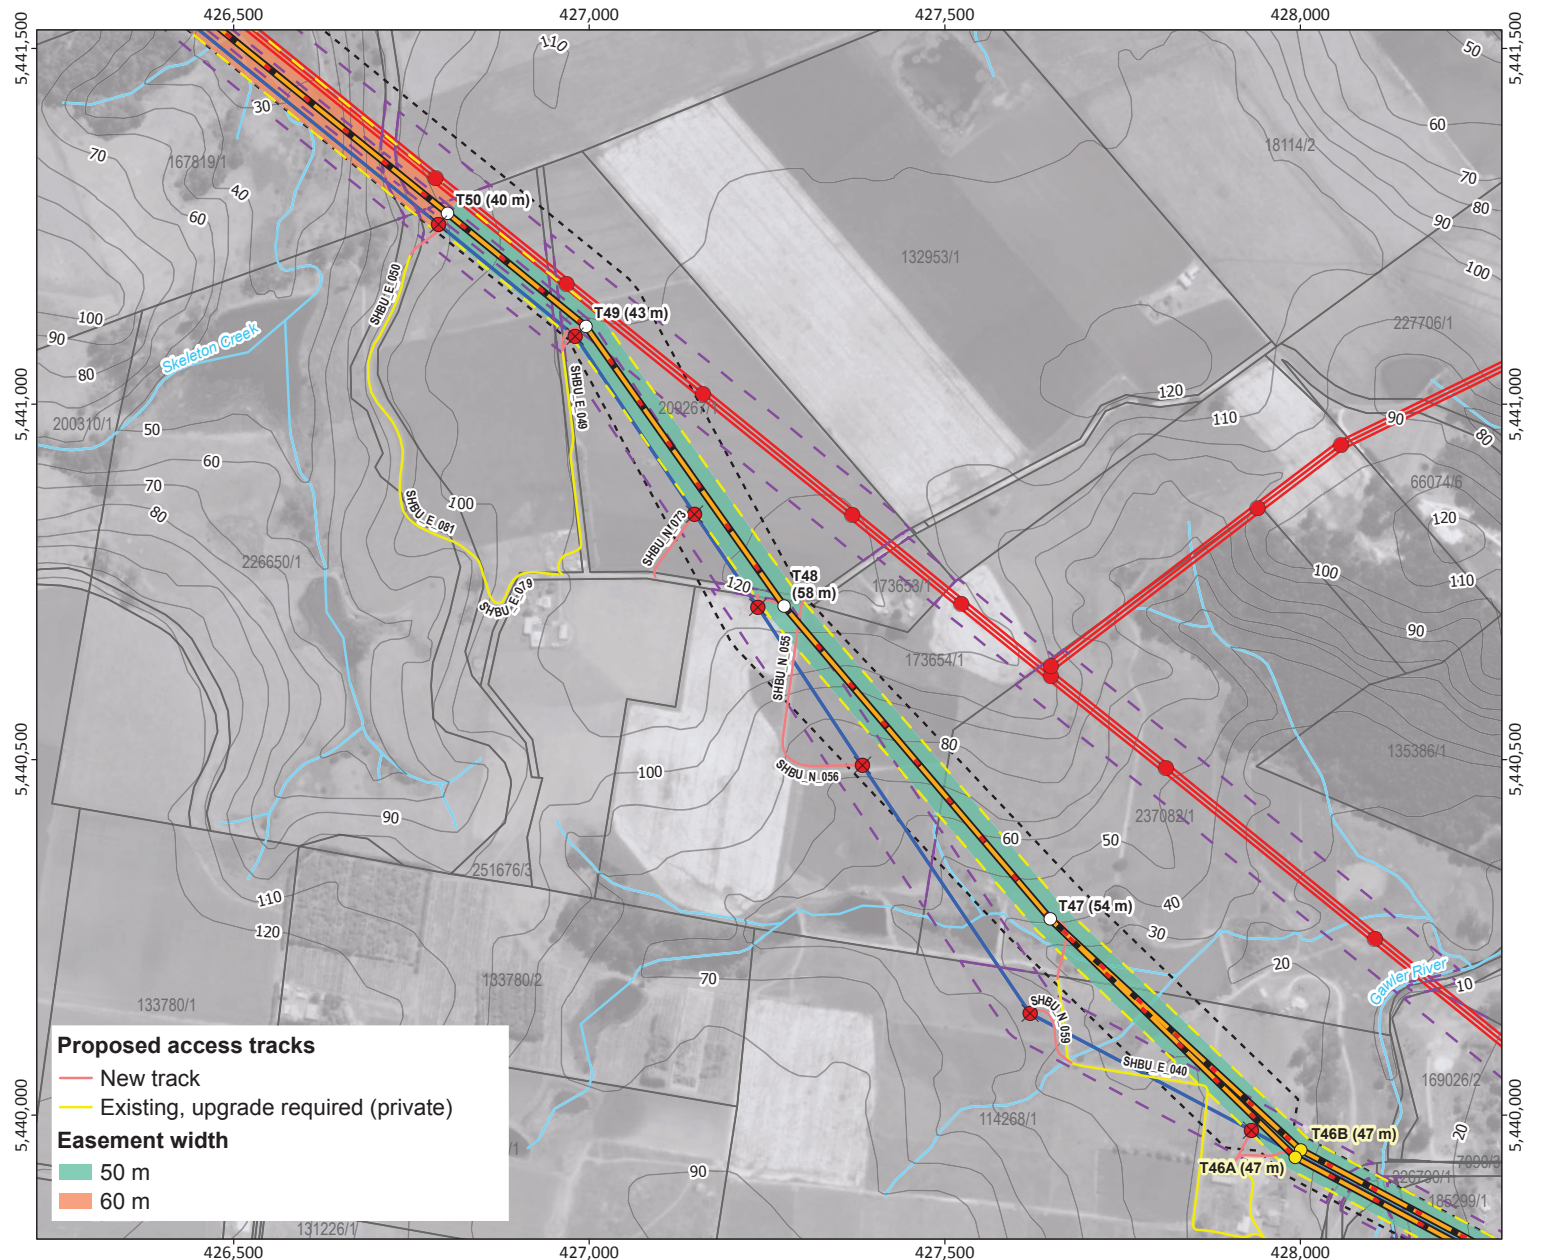


Source: Proposed routes from TasNetworks. Place names, roads, watercourses and LGA boundaries from DPI/PWE. Imagery from ESRI Online.
TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
© TasNetworks 2025


Figure A8.8
Overhead transmission line
site plans – project
infrastructure (map 55 of 82)

Legend

- Proposed tower
- Proposed 220 kV dual monopole
- ⊗ Existing tower to be decommissioned
- Existing tower
- Proposed 220 kV OHTL
- Relocated 110 kV OHTL
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- Watercourse
- 10 m contour
- Proposed easement
- Existing easement
- Notified corridor
- Cadastre
- Local Government Area (LGA)

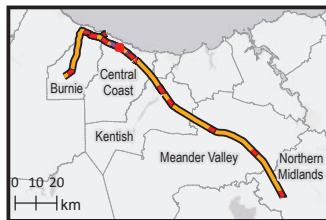

Coordinate System: GDA 1994 MGA Zone 55
 Projection: Transverse Mercator
 Datum: GDA 1994
 Date: 19/12/2025 2:30 PM
 Prepared by: Tetra Tech Coffey

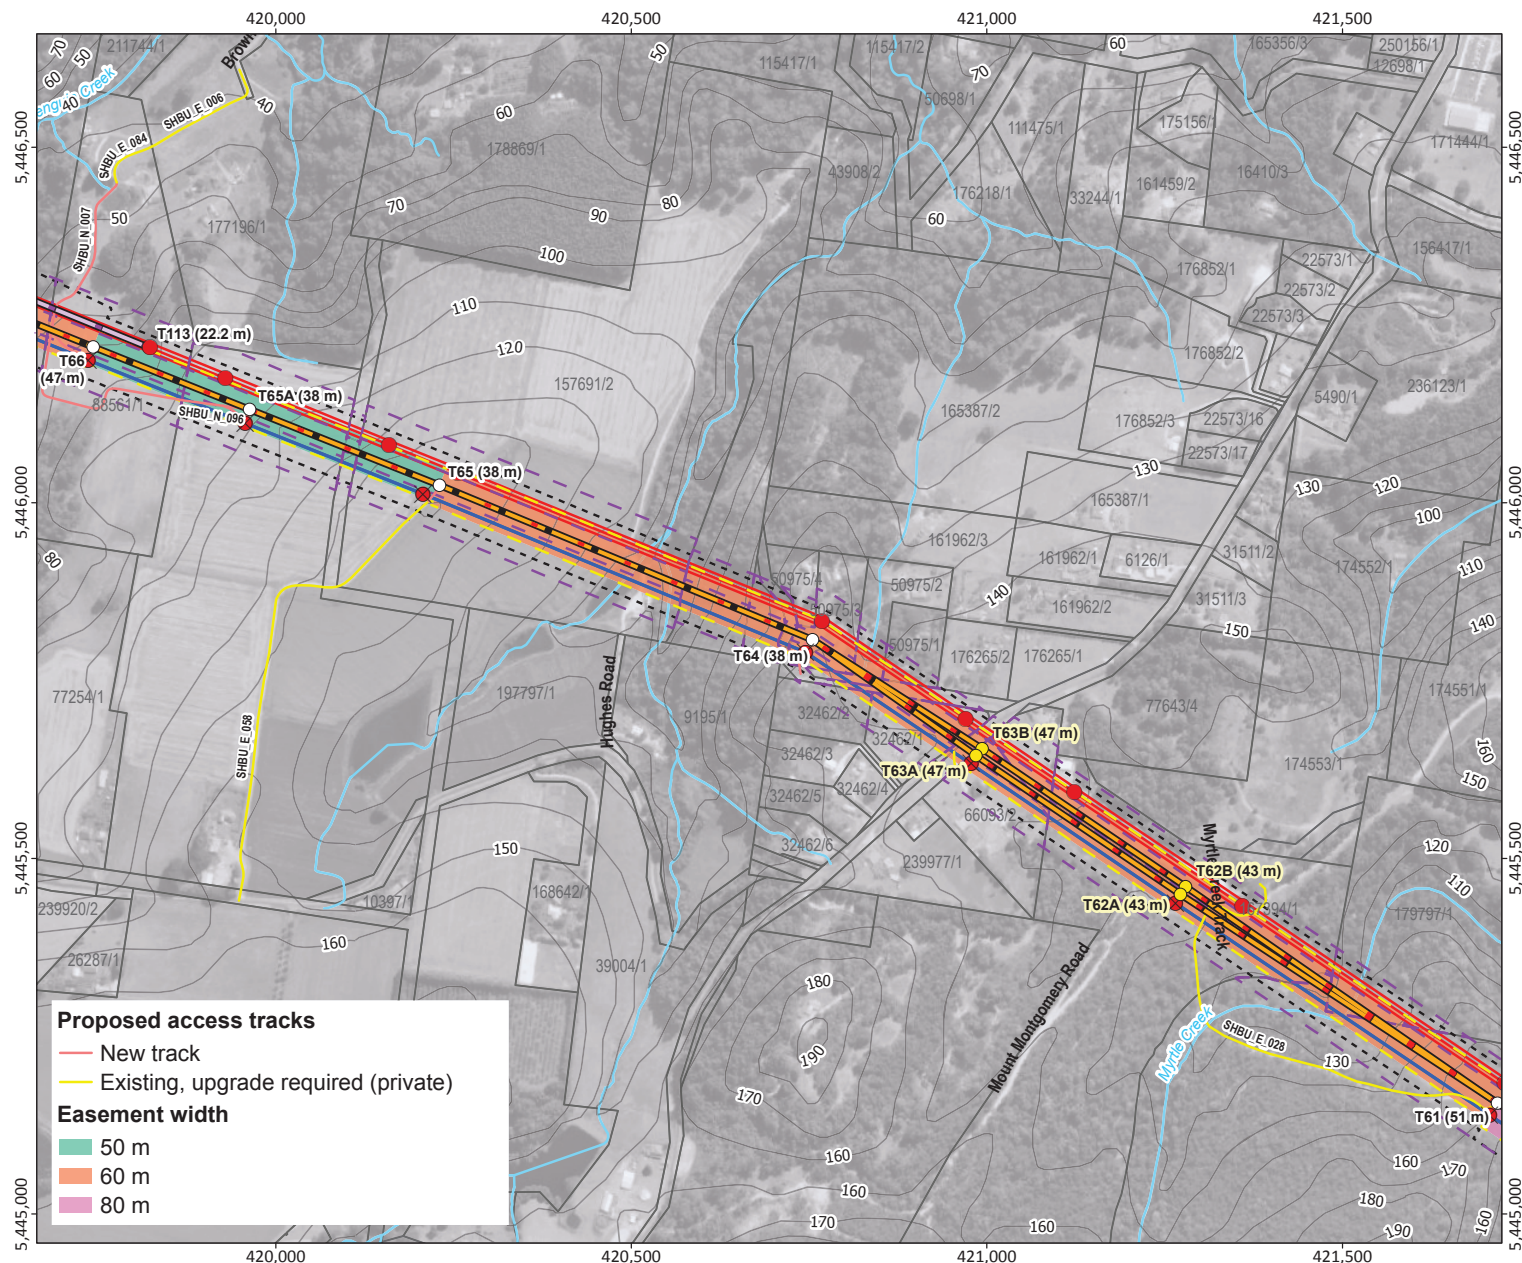


Source: Proposed routes from TasNetworks. Place names, roads, watercourses and LGA boundaries from DPI/PWE. Imagery from ESRI Online.
 TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
 © TasNetworks 2025


Figure A8.8
Overhead transmission line
site plans – project
infrastructure (map 60 of 82)

Legend

- Proposed tower
- Proposed 220 kV dual monopole
- Winch drum and brake site
- ⊗ Existing tower to be decommissioned
- Existing tower
- Proposed 220 kV OHTL
- Relocated 110 kV OHTL
- Existing 110 kV OHTL
- Existing 220 kV OHTL
- Watercourse
- 10 m contour
- Proposed easement
- Existing easement
- Notified corridor
- Cadastre
- Local Government Area (LGA)

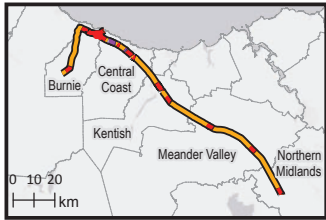

N
 Scale (A4): 1:10,000
 200 0 200 m
 Coordinate System: GDA 1994 MGA Zone 55
 Projection: Transverse Mercator
 Datum: GDA 1994
 Date: 19/12/2025 2:30 PM
 Prepared by: Tetra Tech Coffey

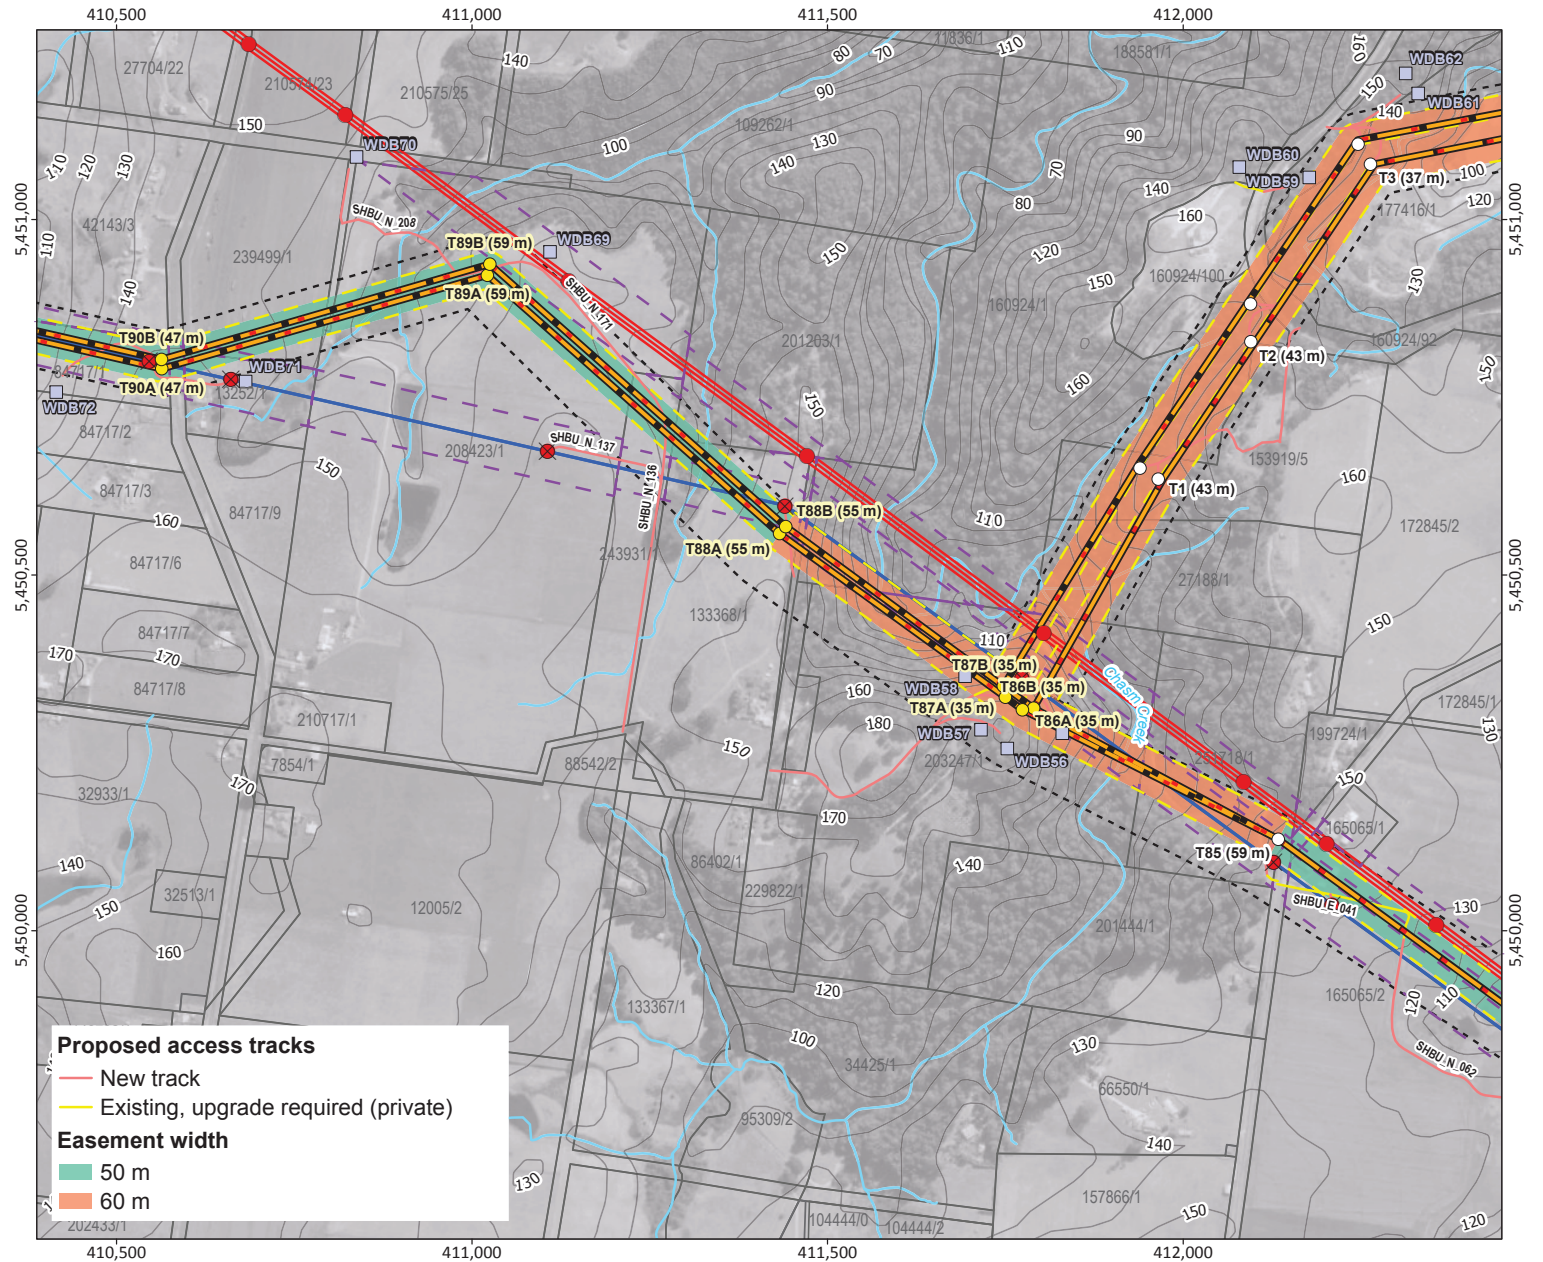

Source: Proposed routes from TasNetworks. Place names, roads, watercourses and LGA boundaries from DPI/PWE. Imagery from ESRI Online.
 TasNetworks has made every effort to ensure this product is free of errors but does not warrant the map or its features are either spatially or temporally accurate or fit for a particular use. TasNetworks provides this map without any warranty of any kind whatsoever, either express or implied.
 © TasNetworks 2025